

Water Resources Act 1991
as amended by the Environment Act 1995



ENVIRONMENT
AGENCY

Consents to Discharge
Certificate of Holder

Part A

To: Somers Forge Ltd
Prospect Road
Halesowen
West Midlands
B62 8DZ

Environment Act 1995 Schedule 23

- 4 DEC 1996

Date of Letter:

Date to DCRS:

Date Filed:

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent S/06/50212/T

MODIFIED: S/06/55034/T

Nature of Discharge(s); Trade Effluent
at Somers Forge Ltd/Prospect Road/Halesowen/West Midlands/B62 8DZ

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor. To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

Part B Please complete in block capitals or type.

To: The Environment Agency, Water Quality Section (Consents), Olton Court, 10 Warwick Road, Olton, Solihull B92 7HX

Water Resources Act 1991: Notice of transfer of consent to discharge

Consent S/06/50212/T

Name: Somers Forge Ltd
Address: Prospect Road
Halesowen
West Midlands
B62 8DZ

I/We* hereby serve notice on the Agency that I/we* am/are* no longer a/the* Holder of the above consent which will be/was* transferred to: * delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s):

Signed:..... Dated:.....

Name (block capitals):..... Position:.....

(to be completed when signing on behalf of corporate bodies)





**ENVIRONMENT
AGENCY**

CONSENT NO.	S/6/55034/T
-------------	-------------

**WATER RESOURCES ACT 1991
(AS AMENDED BY THE ENVIRONMENT ACT 1995)
SECTION 88 - SCHEDULE 10
NOTICE OF MODIFICATION OF CONSENT TO DISCHARGE**

TO: Somers Forge Ltd
Forge House
Dudley Road
Lye
West Midlands

The **ENVIRONMENT AGENCY** ("The Agency") in pursuance of its powers under the above mentioned Acts **HEREBY MODIFIES** the conditions subject to which Consent No. S/6/50212/T was given to Somers Forge Ltd on 29 March 1996 by the National Rivers Authority in respect of the making of a discharge of effluent as described in the attached Schedule and as from the date hereof **CONSENTS** to the making of such a discharge.


FROM: Somers Forge Limited, Haywood Forge, Prospect Road, Halesowen

SUBJECT TO the conditions set out in the following schedule:

Supernatant water from the cooling water storage and recirculation lagoon Schedule No. S/6/55034/T 01

Subject to the provisions of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Agency, altering this consent without the agreement in writing of the discharger, during a period of two years from the date this consent takes effect or such later date as may be specified in an endorsement to this document.

This consent is issued and takes effect on the tenth day of October 1996

Signed
An 

The Environment Agency, Upper Severn Area,
Hafren House, Shelton, Shrewsbury SY3 8BB

CONSENT NO.	S/6/55034/T
SCHEDULE NO.	S/6/55034/T 01
DATE ISSUED	10th October 1976

CONDITIONS OF CONSENT TO DISCHARGE

TRADE EFFLUENT ("the discharge")

FROM: SOMERS FORGE LIMITED, HAYWOOD FORGE, PROSPECT ROAD, HALESOWEN

- 1 (a) The Discharge shall not contain any poisonous, noxious, or polluting matter or solid waste matter.
(b) Provided that the Discharge hereby consented is made in accordance with the following conditions of this consent, such discharge shall not be taken to be in breach of condition (a) above by reason of containing substances or having properties identified in and controlled by these conditions.
- 2 The Discharge shall consist solely of supernatant water from the cooling water storage and recirculation lagoon.
- 3 The Discharge shall be made in the manner and at the place specified as:
 - (a) discharging to the River Stour
 - (b) at National Grid Reference SO 9687 8410
 - (c) shown marked "OUTFALL" on attached Drawing No. S/6/55034/T 01/D1.
- 4 A sample point shall be provided and maintained at National Grid Reference SO 9714 8421, as shown marked "SAMPLING POINT" on attached Drawing No. S/6/55034/T 01/D2, or some other point as agreed in writing with the Agency, so that a representative sample of the Discharge may be obtained. The discharger shall ensure that all constituents of the Discharge pass through the said sampling point at all times and in any legal proceedings it shall, for the purposes of Section 10 of the Rivers (Prevention of Pollution) Act 1961, be presumed, until the contrary is shown that any sample of the Discharge taken at the said sampling point is a sample of what was discharging into controlled waters.
- 5 The rate of discharge shall not exceed 8.2 litres per second.

- 6 The composition of the Discharge shall be such that:
- (a) the biochemical oxygen demand (determined in the presence of 0.5 milligrams per litre of allyl-thiourea after 5 days at 20 degrees Celsius) shall not exceed 25 milligrams per litre.
 - (b) suspended solids, dried at 105 degrees Celsius, shall not exceed 45 milligrams per litre.
 - (c) there shall be no visible oil or grease in the receiving watercourse as a result of the discharge.
- 7 A discharge of effluent shall not occur on more than four calendar days per year.
- 8 As far as is reasonably practicable, the Discharge shall not contain any matter, other than matter specifically covered by numerical conditions in this consent, to such an extent as to cause the receiving waters, or any waters of which the receiving waters are a tributary, to be poisonous or injurious to fish in those waters, or to the spawning grounds, spawn or food of fish in those waters, or otherwise cause damage to the ecology of those waters or to have any other adverse environmental impact.

Dated this *tenth*

day of *October*

1996

Area

anager

WARLEY CB & CP
LONG
2° 04' W


WARLEY WEST BORO CONST

HALESOWEN AND STOURBRIDGE B

285000m

96

97

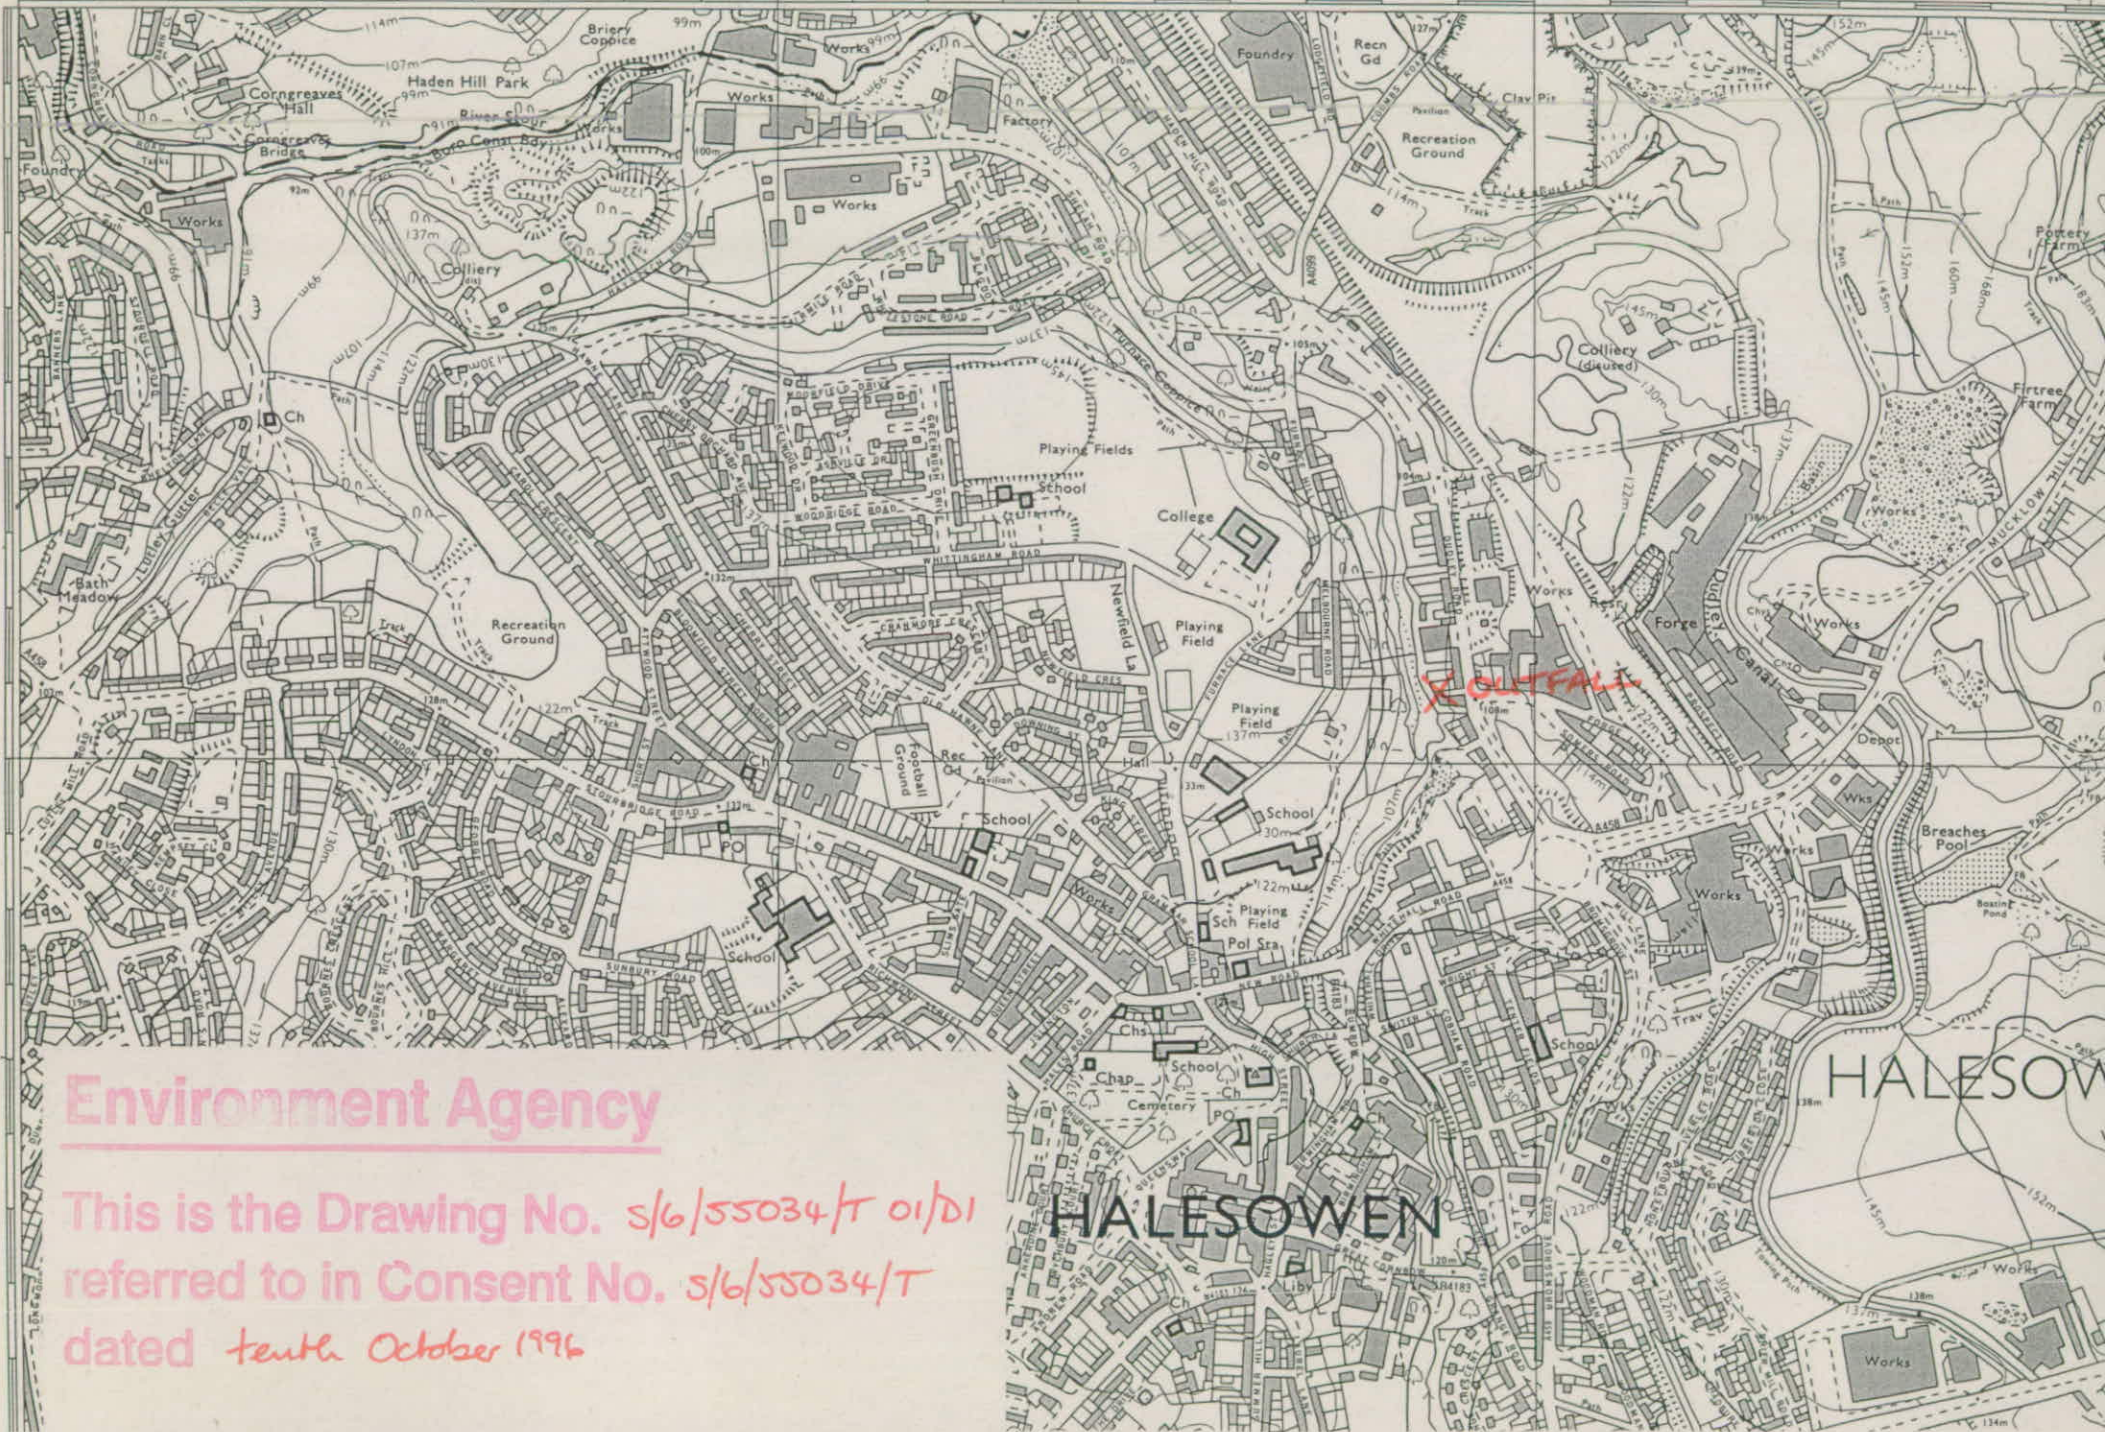

84

LAT
52° 27'


Environment Agency

This is the Drawing No. *s/6/55034/T 01/D1*
referred to in Consent No. *s/6/55034/T*
dated *tenth October 1996*

HALESOWEN

HALESOW

22-7-70

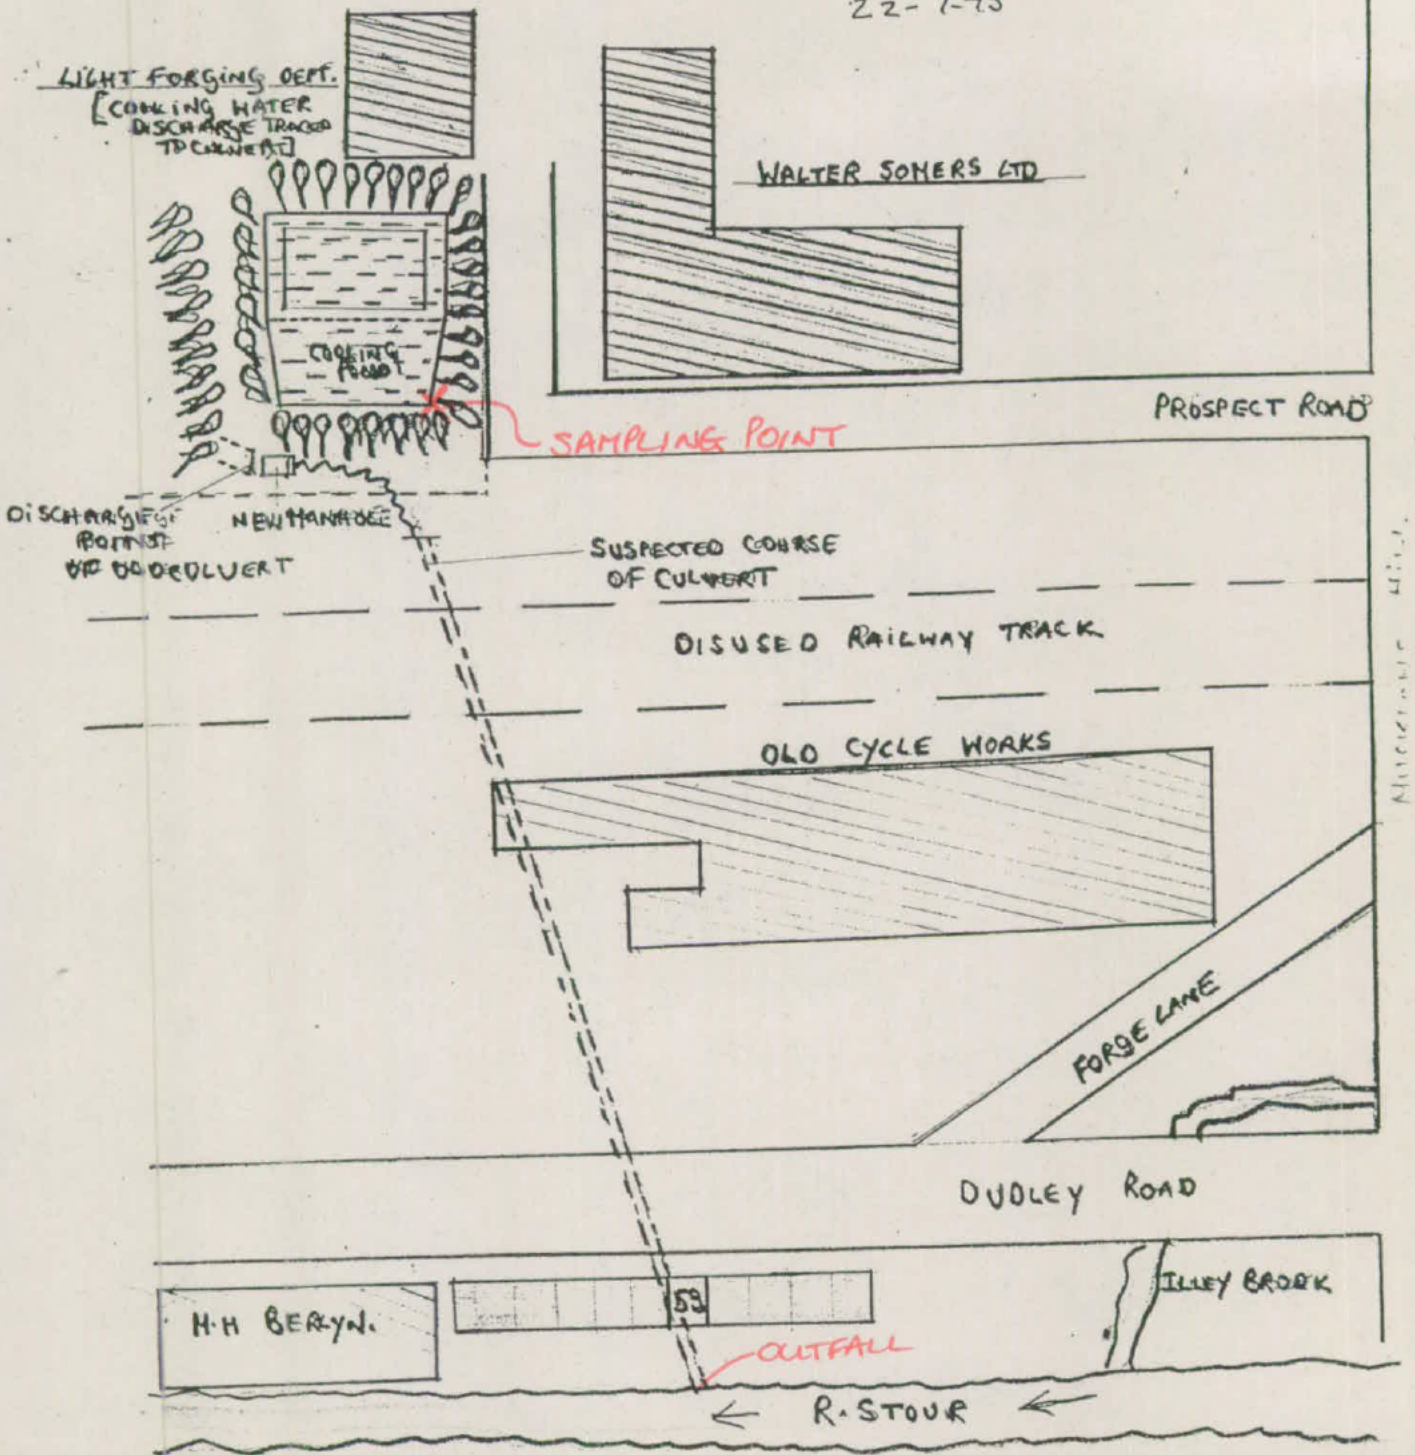

Environment Agency

This is the Drawing No. S/6/55034/T 01/D2
 referred to in Consent No. S/6/55034/T
 dated tenth October 1996



Consent No S/6/50212/T
(formerly Consent No A.240)

WATER RESOURCES ACT 1991

MODIFICATION OF CONSENT CONDITIONS

TO: Somers Forge Ltd
Forge House
Dudley Road
Lye
West Midlands

The NATIONAL RIVERS AUTHORITY ("the Authority" which expression shall include any statutory successor to The Authority) whose principal office is at Rivers House Waterside Drive Aztec West Almondsbury Bristol BS12 4UD in exercise of its powers under the above mentioned Act and of all other powers enabling it in that behalf HEREBY MODIFIES the conditions subject to which Consent No. A.240 (subsequently renumbered S/6/05640/T) was given to Walter Somers Limited on 28 August 1970 by the Severn River Authority in respect of the making of a discharge of effluent as described in the attached Schedule and as from the date hereof CONSENTS to the making of such a discharge subject to the conditions set out in that Schedule in place of the conditions previously imposed.

This consent shall take effect from the date set out hereunder and subject to the provisions of Paragraphs 6 and 7 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Authority, altering this consent without the agreement in writing of the discharger, during a period of two years from that date.

Dated this *twenty ninth* day of *March* 19*96*

Area Manager

National Rivers Authority
Severn-Trent Region
Hafren House
Shelton
Shrewsbury SY3 8BB

SCHEDULE OF CONDITIONS

PREMISES FROM WHICH DISCHARGE IS MADE

- 1 Somers Forge Limited, Haywood Forge, Prospect Road, Halesowen.

NATURE OF DISCHARGE

- 2 Supernatant water from the cooling water storage and recirculation lagoon.

RECEIVING WATERS

- 3 River Stour.

CONDITIONS (In addition to those above)

- 4 (a) The discharge shall not contain any poisonous, noxious or polluting matter or solid waste matter.

(b) Provided that the discharge hereby consented is made in accordance with the other conditions of this consent, such discharge shall not be taken to be in breach of condition (a) above by reason of containing substances or having properties identified in and controlled by those conditions.
- 5 The discharge of effluent shall be made only from an outlet located at OS National Grid Reference SO 9687 8410 as shown marked "OUTFALL" on the attached Drawing Nos S/6/50212/T/1 and S/6/50212/T/2.
- 6 Facilities for the taking of samples shall be provided and maintained to the satisfaction of the Authority and be accessible at all times to authorised officers of the Authority at an inspection chamber at the point shown marked "SAMPLING POINT" on attached Drawing No S/6/50212/T/2.
- 7 The composition of the effluent shall be such that:
 - (a) the biochemical oxygen demand (determined in the presence of 0.5 milligrams per litre of allyl-thiourea after 5 days at 20 degrees Celsius) shall not exceed 25 milligrams per litre.
 - (b) suspended solids, dried at 105 degrees Celsius, shall not exceed 45 milligrams per litre.
 - (c) there shall be no visible oil or grease in the receiving watercourse as a result of the discharge.

SCHEDULE TO CONSENT NO. S/6/50212/T CONT'D

- 8 The effluent shall be discharged such that:
- (a) the volume in any period of 24 consecutive hours shall not exceed 681 cubic metres.
 - (b) the rate of discharge shall not exceed 8.2 litres per second.
- 9 As far as is reasonably practicable, the discharge shall not contain any matter other than matter specifically covered by numerical conditions in this consent to such an extent as to cause the receiving waters, or any waters of which the receiving waters are a tributary, to be poisonous or injurious to fish in those waters, or to the spawning grounds, spawn or food of fish in those waters, or otherwise cause damage to the ecology of those waters, or to have any other adverse environmental impact.

Dated this *twenty-ninth*

day of *March*

1996


Area Manager



285000m

84

LAT
52° 27'


National Rivers Authority

This is the Drawing No. *s/6/50212/T/1*
referred to in Consent No. *s/6/50212/T*
dated *twenty-ninth March 1996*

HALESOWEN

HALESOW

22-7-70

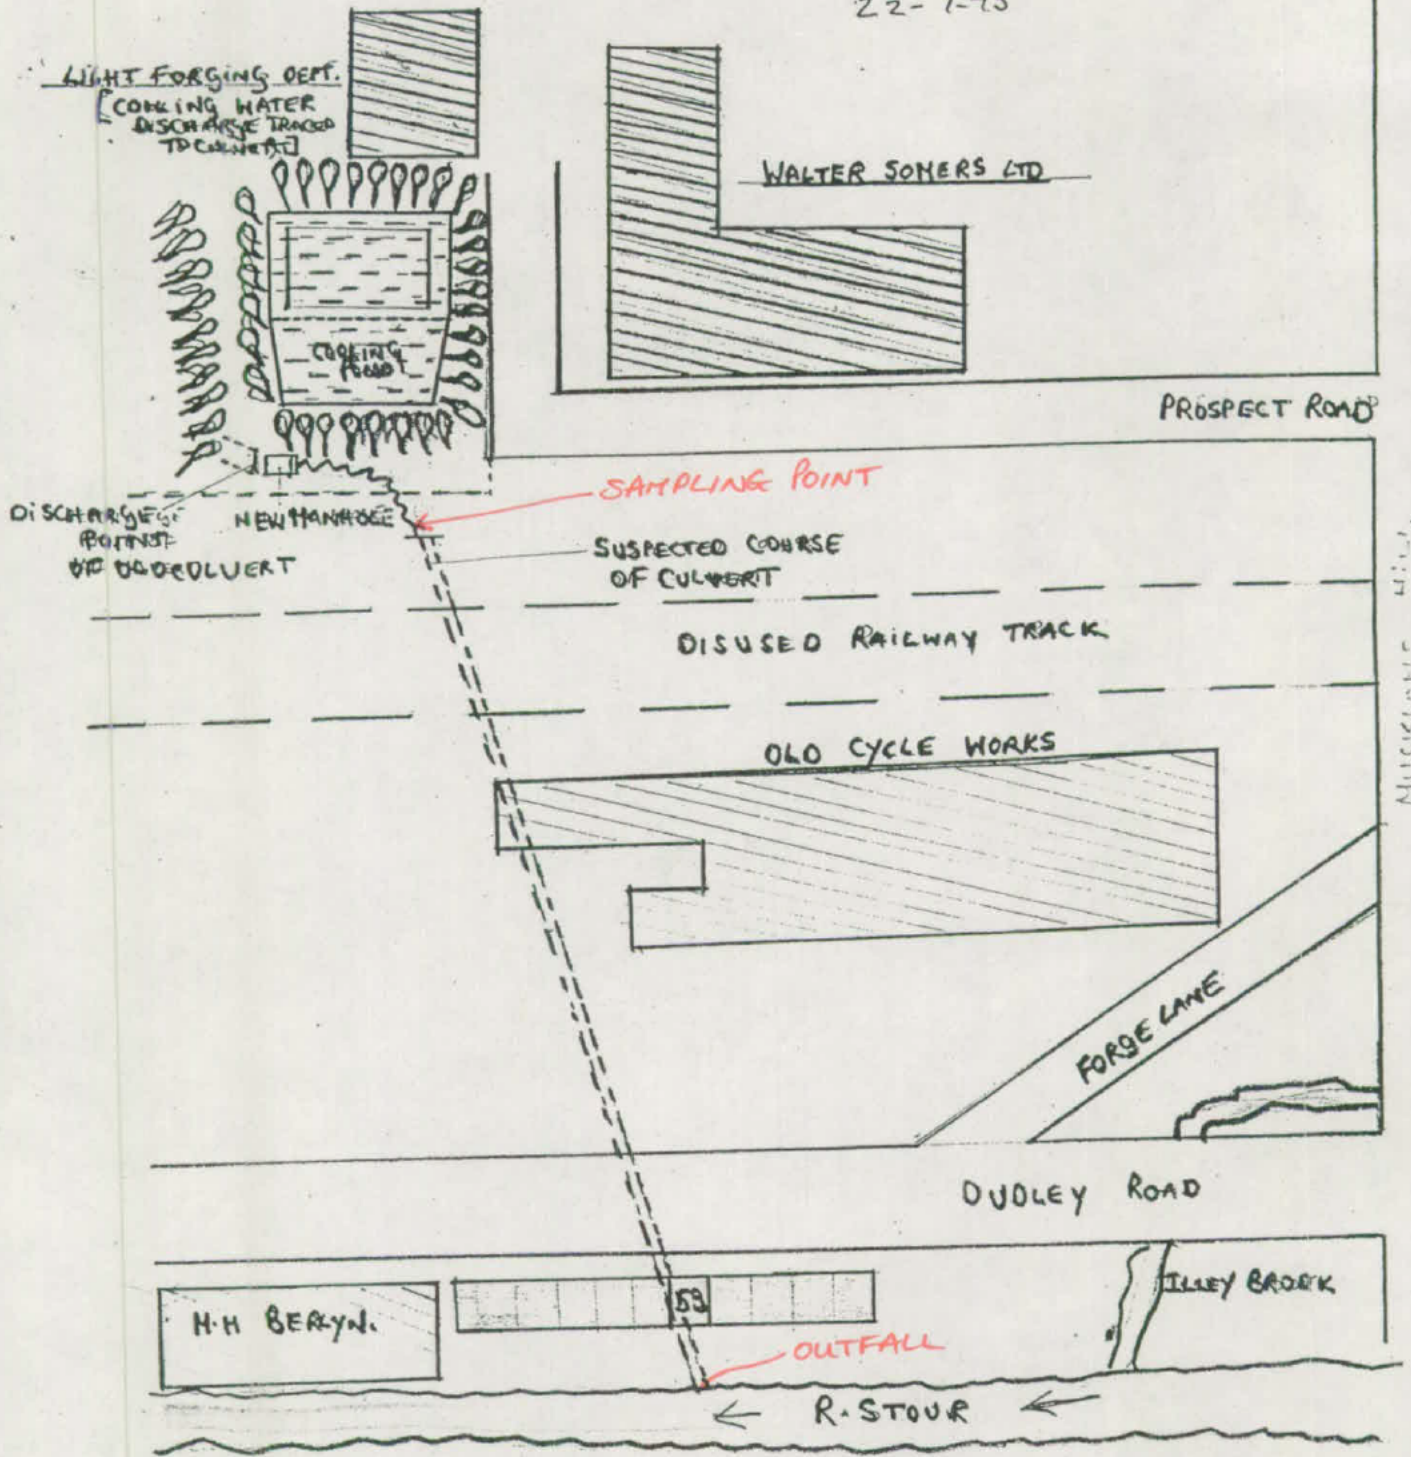

National Rivers Authority

This is the Drawing No. S/6/50212/T/2
referred to in Consent No. S/6/50212/T
dated twenty-ninth March 1996

POOR ORIGINAL

SEVERN RIVER AUTHORITY

Rivers (Prevention of Pollution) Acts 1951 to 1961

To Walter Somers Limited,
Haywood Forge, P.O. Box No. 7,
Halesowen, Worcestershire.

The SEVERN RIVER AUTHORITY hereby :-

~~CONSENTS to the new outlet and new discharge of effluent, as referred to in~~
[your application dated], [the application dated]
and submitted by],
from
into
subject to conditions as set out hereunder.

GIVES NOTICE imposing conditions in respect of the discharge of effluent from
Haywood Forge, Halesowen
into the River Stour at N.G.R. SO 973 842
as set out hereunder.

The terms of this [~~consent~~] [notice] will not, without the consent in writing of the person to whom this [~~consent~~] [notice] is given (or his successor), be altered before the expiration of the period ending with the 28th day of August, 19 72 .

- (a) The discharge shall consist solely of supernatant water from the cooling water storage and recirculation lagoon.
- (b) A sample of the effluent taken at the agreed sampling point shall:-
 - (i) not contain more than 30 milligrammes per litre of suspended solids dried at 105°C.
 - (ii) not take up more than 20 milligrammes per litre of dissolved oxygen in 5 days at 20°C.
 - (iii) not contain more than 0.5 milligrammes per litre of chromium, cadmium, copper, lead, nickel or zinc, either singly or in any combination.
 - (iv) not contain more than 4 milligrammes per litre total oil and grease.
- (c) The rate of discharge shall not exceed 6,500 gallons per hour.
- (d) The volume of discharge shall not exceed 150,000 gallons in any period of 24 hours.

FF.3.

Dated this 28th day of August 19 70

PORTLAND HOUSE,
CHURCH STREET,
MALVERN,
WORCS.

Clerk of the Authority.

NOTE: Section 6 of the Rivers (Prevention of Pollution) Act 1961 provides that any question as to the unreasonableness of the terms of any consent or notice of this kind shall be determined by the Minister of Housing and Local Government. Any reference to the Minister for this purpose must be made within three months from the giving of the consent or notice.