

CONDITIONS ATTACHED TO CONSENT


The rate of discharge of effluent to the stream shall be limited to the amount by which the rate of flow in the sewer draining to the Pumping Station is at the time of discharge in excess of 1,200 gallons per minute EXCEPT when the Pumping Station ceases to operate due to circumstances outside the control of the Council and it is not reasonably practicable to dispose of the sewage otherwise.

The terms of this Consent will not, without the consent in writing of the person to whom this Consent is given (or his successor) be altered before the expiration of the period ending with the *Twenty fourth* day of *October* *1969*

This is the Drawing No. 2091/1
referred to in Consent No. 2091

Sanjour

Clerk of the Authority

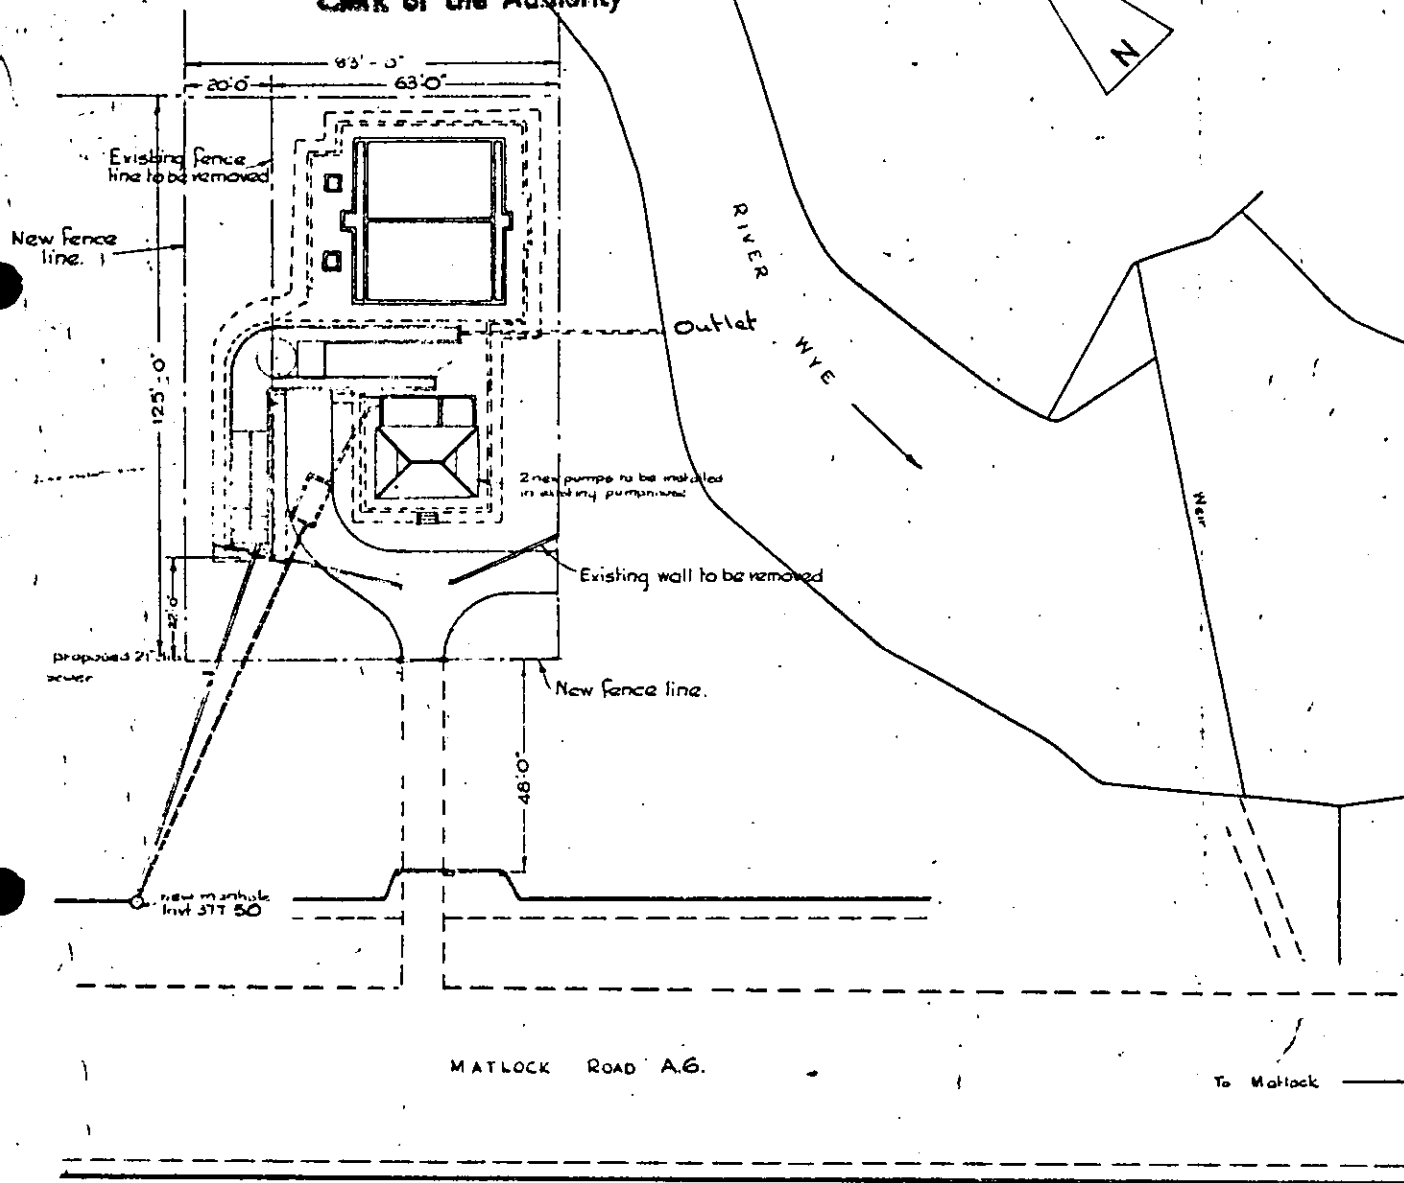

Scale: 40ft to 1 inch

SITE PLAN