

26 X

NATIONAL RIVERS AUTHORITY
WESSEX REGION

WATER RESOURCES ACT 1991
SECTION 88 AND SCHEDULE 10

LAPSED

NOTICE OF CONSENT TO DISCHARGE
Consent Number 042447

with effect from
11/10/93

The terms of this consent will not, without the consent in writing of the person (named below) to whom this consent is given (or his successor), be altered before the expiration of the period ending two years after the date on which the consent takes effect.
If you are not satisfied with the terms of this consent you may appeal to the Secretary of State for the Environment; any such appeal has to be made within three months of the issue of the consent.

SIGNED FOR AND ON BEHALF OF THE AUTHORITY

[Signature]
Catchment Planning Manager

DATE *25/6/93*

Name and Location of Site	New Forest Farm Machinery Ltd Salisbury Road Blashford, Ringwood, Hants
Name and address of person to whom this consent is given	New Forest Farm Machinery Ltd Honey Lane Burley, Ringwood, Hants

The conditions specified in this consent shall apply on and after the date of issue of this consent.

National Rivers Authority
Wessex Region
Rivers House
East Quay
BRIDGWATER
Somerset
TA6 4YS

Consent Number: 042447

Name of Site: New Forest Farm Machinery Ltd
Salisbury Road, Blashford, Ringwood

Name of person or body responsible for the operation of the site: New Forest Farm Machinery Ltd

Name of receiving stream: discharge to soakaway
in the Lower Avon Catchment

National Grid Reference of site main entrance: SU 1498 0701

The outlet at this site to which the consent relates is listed below and is marked on the attached plan using the same reference code.


Outlet		Sampling Point	
Code	NGR	Number	NGR
A	SU 1494 0699	Not	applicable

CONSENT CONDITIONS

1. Outlet A shall be used only for the discharge of septic tank effluent.
2. The maximum daily volume of effluent discharged via Outlet A shall not exceed 1 m³/day.
3. The septic tank shall be adequately sized and constructed in accordance with BS 6297:1983, Section 9.
4. The soakaway shall be constructed in accordance with BS 6297:1983, Section 15.3.
5. The septic tank and soakaway shall have no direct connection with a watercourse, ditch, surface water drain, land drain or water contained in underground strata.
6. No part of the soakaway shall be situated within 6 metres of any watercourse.
7. The installation shall be adequately maintained including the removal of accumulated sludge as necessary.

NATIONAL RIVERS AUTHORITY
WESSEX REGION

Consent Number: 042447

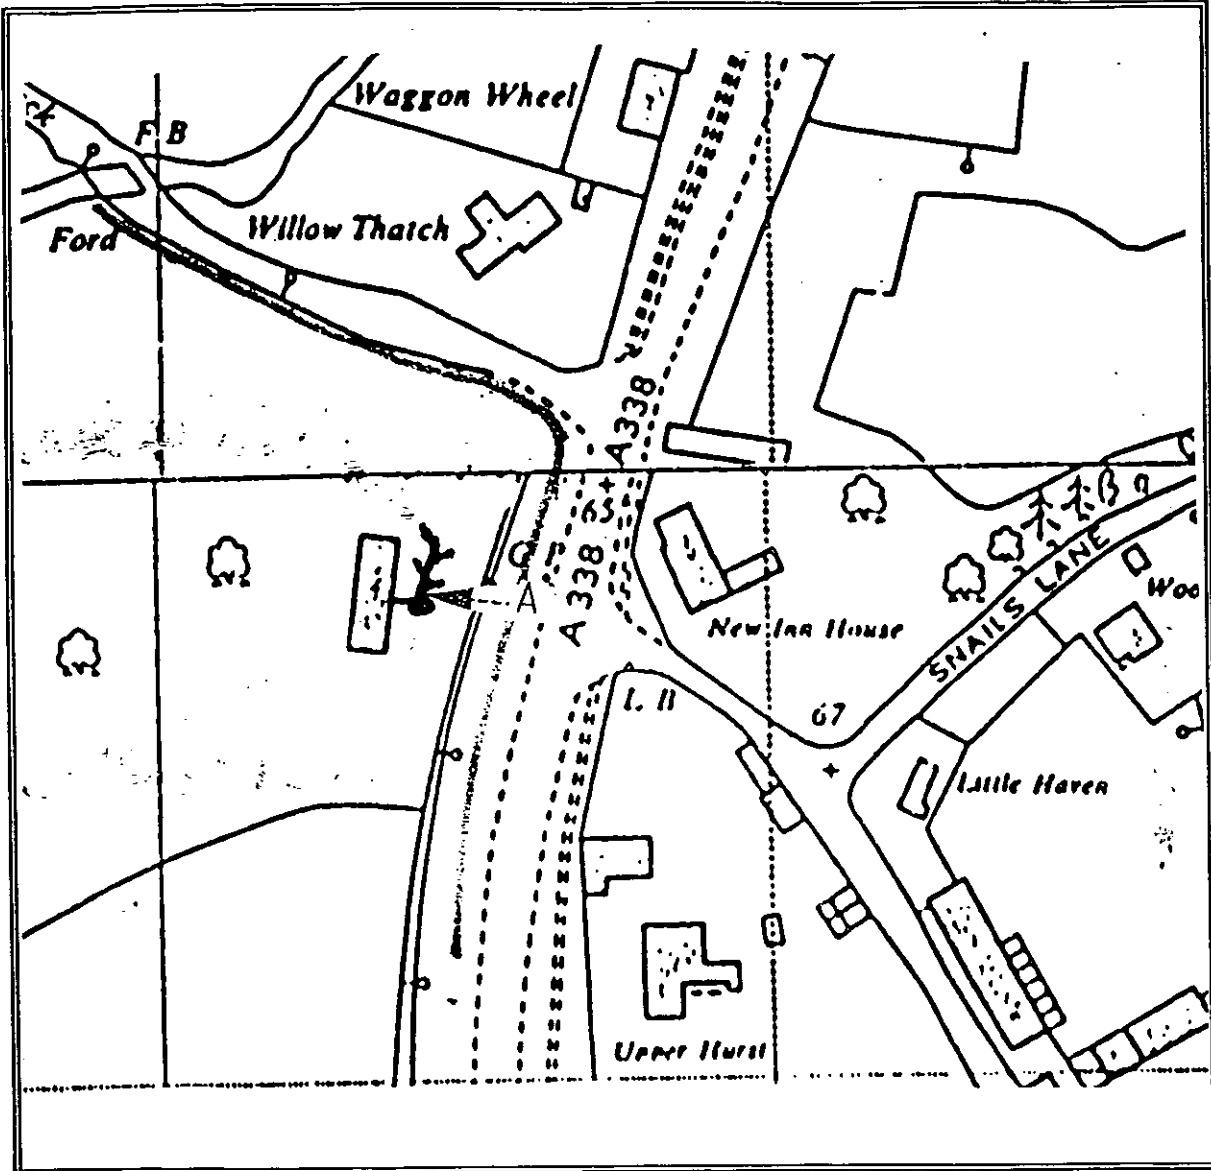

Date: MAY 1993

Outlet:
A / SU 1494 0699

Sample Point:
not applicable

NEW FOREST FARM MACHINERY
LTD

SALISBURY ROAD, BLASHFORD

RINGWOOD, HANTS

NATIONAL RIVERS AUTHORITY
WESSEX REGION

Consent Number: 042447



Date: MAY 1993


Outlet:
A / SU 1494 0699

Sample Point:
not applicable

NEW FOREST FARM MACHINERY
LTD

SALISBURY ROAD, BLASHFORD

RINGWOOD, HANTS



Consent Number: 042447

This consent includes a copy of an ordnance survey map showing the location of the land or premises, the outlet to which this consent relates and other immediate surroundings.

This consent includes a copy of an outline plan showing the location of the outlet, the entrance to the land and premises and the principal adjacent structures. The outlet marked on the plan has the same designation as that used in the consent.

Any conditions imposed by this consent unless annulled or varied by the Secretary of State upon appeal under Section 91 of the Water Resources Act 1991 shall continue in force unless and until varied or revoked by the National Rivers Authority or by the Secretary of State under Section 91 of the said act: and any such conditions are binding on any person discharging effluent from the land or premises to which the conditions relate.

Failure to comply with the terms of this consent is an offence under Section 85 of the Water Resources Act 1991.