

**Water Resources Act 1991**  
as amended by the Environment Act 1995  
**Consent to Discharge**  
**Certificate of Holder**



**ENVIRONMENT  
AGENCY**

**Part A**

**To:** YORKSHIRE WATER SERVICES LIMITED  
Western House  
Halifax Road  
Bradford  
BD6 2SZ

The Environment Agency ("the Agency") hereby confirm that the above named person is a/the registered holder of consent: WRA7773

Nature of Discharge(s); Sewage in an Emergency  
Edward Road Sewage Pumping Station, Adwick-Le-Street, Doncaster

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor. To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

**Part B Please complete in block capitals or type.**

**To:** THE ENVIRONMENT AGENCY

**Water Resources Act 1991: Notice of transfer of consent to discharge**

**Consent:** WRA7773      **Name:** YORKSHIRE WATER SERVICES LIMITED  
Western House  
Halifax Road  
Bradford  
BD6 2SZ

I/We\* hereby serve notice on the Agency that I/we\* am/are\* no longer a/the\* Holder of the above consent which will be/was\* transferred to: \* delete as appropriate

**Name(s) of new holder(s):**

**Address:**

**Post Code:**

**Date of Transfer to new Holder(s):** .....

**Signed:** .....

**Dated:** .....

**Name (block capitals):** .....

**Position:** .....



Consent No: WRA7773

WATER RESOURCES ACT 1991 - SECTION 88 - SCHEDULE 10

(AS AMENDED BY THE ENVIRONMENT ACT 1995)

**CONSENT TO DISCHARGE**

To: YORKSHIRE WATER SERVICES LIMITED  
Western House  
Halifax Road  
Bradford  
BD6 2SZ

The ENVIRONMENT AGENCY in pursuance of its powers under the Water Resources Act 1991 (As amended by the Environment Act 1995) **HEREBY CONSENTS** to the making of a discharge, **OF SEWAGE EFFLUENT** as follows:

Sewage in an Emergency

From: Edward Road Sewage Pumping Station

At: Adwick-Le-Street, Doncaster


To: Bowling Alley Drain

**SUBJECT TO** the conditions set out in the following schedules:

Schedule 1 - Sewage in an Emergency

Subject to the provisions of Paragraphs 7 and 8 of Schedule 10 of the Water Resources Act 1991 (as amended by Schedule 22 of the Environment Act 1995), no notice shall be served by the Agency, altering this consent without the agreement in writing of the Consent Holder, during a period of 4 years from the date this consent takes effect or such later date as may be specified in an endorsement to this document.

This consent is issued and takes effect on the 26<sup>th</sup> day of February 2002

Signed.....  
  
**Peter Baker, Team Leader – Water Quality Consents**

## CONDITIONS OF CONSENT TO DISCHARGE

**Nature of effluent:** Sewage in an Emergency ("the Discharge")  
**From:** Edward Road Sewage Pumping Station, Adwick-Le-Street, Doncaster  
**To:** Bowling Alley Drain  
**NGR:** SE 5462 0883

### CONDITIONS 1 - 14

#### NATURE OF DISCHARGE

1. The Discharge shall consist solely of sewage in an emergency.

#### PLACE OF DISCHARGE

2. The Discharge shall be made via an outlet at National Grid Reference SE 5462 0883 into Bowling Alley Drain.

#### SAMPLE POINT

3. The outlet to the watercourse shall be constructed and maintained so that a representative sample of the Discharge may be obtained at National Grid Reference SE 5462 0883, as shown marked "Discharge Point" on the attached plan.

#### OCCURRENCE

4. The Discharge shall only occur when the sewage pumping station is inoperative as a result of one or more of the following:
  - a) electrical power failure not due to the act or default of the Consent Holder, its agents, representatives, officers, employees or servants;
  - b) mechanical breakdown of duty and standby pumps;
  - c) rising main failure;
  - d) blockage of the downstream sewer not due to the act or default of the Consent Holder, its agents, representatives, officers, employees or servants;

and it is not reasonably practicable to dispose of the sewage otherwise. There shall be no undue delay on the part of the Consent Holder in remedying any such failure or breakdown.

#### STORAGE

5. Storage capacity, equivalent to a total of at least 1 hour of the dry weather flow in the sewer immediately upstream of the pumping station, shall be provided in the pumping station, and/or the upstream sewerage system, above the wet well design top water level.

#### TELEMETRY

6. a) A 24 hour response telemetry alarm system shall be provided and maintained to give notification of failure or breakdown of the pumping station.  
b) The Consent Holder shall take all reasonable remedial measures to return the pumping station to normal operation, as soon as practicable after receipt of warning of failure or breakdown of the pumping station.

#### PUMPS

7. The duty pump(s) shall be maintained in good working order, and at least one stand-by pump shall be provided and maintained.
8. Stand-by pump(s) shall automatically activate should the duty pump(s) become inoperative for reasons other than power failure. The pumping station shall be maintained so that the pump shall automatically reactivate immediately after the power is restored after interruption to the supply.
9. An external pumping equipment facility shall be provided and maintained for use in the event of installed pumps being inoperative.

#### POWER

10. Facilities shall be provided so that a mobile stand-by generator may readily be installed at the pumping station in the event of electrical failure and the Consent Holder shall install and operate such a generator as soon as is practicable after an electrical failure.


#### RECORDING AND REPORTING

11. a) The Consent Holder shall establish and operate a documented maintenance programme and record all non-routine actions undertaken that may have adversely affected the operation of the pumping station. Copies of the programme shall be made available for inspection by the Agency's officers at all reasonable times.  
b) On request the Consent Holder shall supply the Agency with a written report on the maintenance and all non-routine actions that may have adversely affected the operation of the pumping station.

12. On request the Consent Holder shall supply the Agency with a written report on the operation of the emergency overflow.

**OTHER CONDITIONS**

13. A tanker access facility at an appropriate location shall be provided and maintained to enable removal of sewage by tanker when necessary.
14. Where the Discharge results in unsatisfactory solid matter being visible in the receiving waters or on the banks of the receiving waters, in the vicinity of the outfall, the Consent Holder shall take all reasonable steps to collect and remove such matter as soon as reasonably practicable after the discharge has been reported.

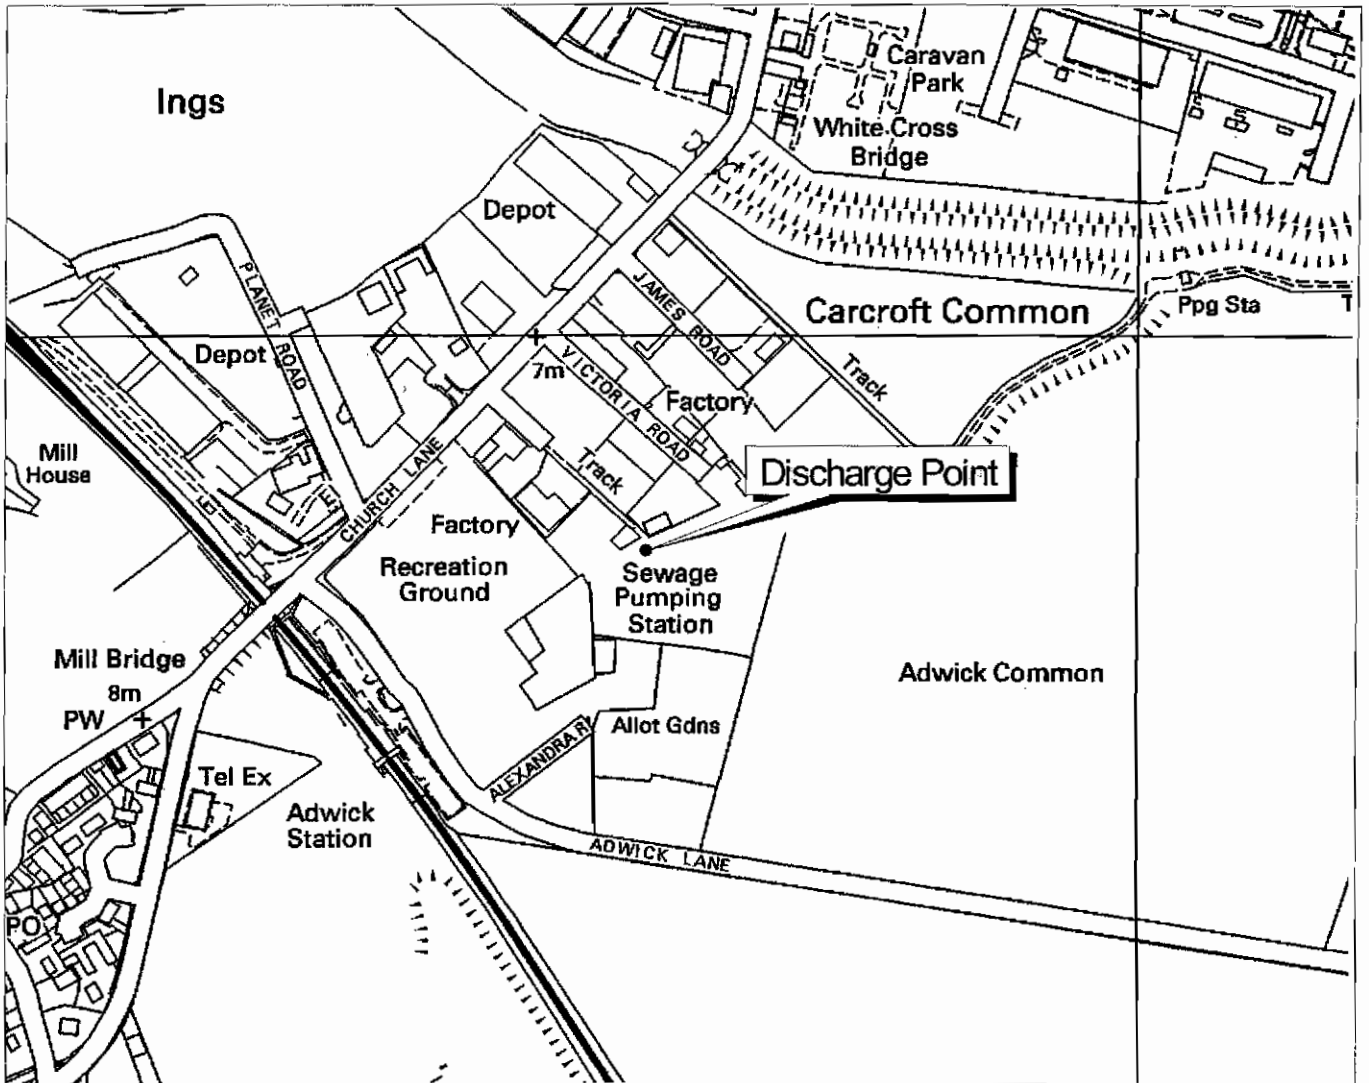

This map is reproduced from the OS map by the Environment Agency with the permission of Ordnance Survey on behalf of The Controller of Her Majesty's Stationery Office, Crown copyright. All rights reserved. Unauthorised reproduction infringes Crown Copyright and may lead to prosecution or civil proceedings. Licence Number 3D03177G

**LOCATION OF: EDWARD ROAD SEWAGE PUMPING STATION, DONCASTER**

**DISCHARGE OF: SEWAGE IN AN EMERGENCY**

**NATIONAL GRID REFERENCE: SE 5462 0883**