

**Water Resources Act 1991**  
as amended by the Environment Act 1995  
**Consent to Discharge**  
**Certificate of Holder**



**ENVIRONMENT**  
**AGENCY**

**Part A**

To:

The Project Manager  
Highways Agency  
P. O. Box 206  
City House  
New Station Street  
Leeds  
LS1 4UR

The **Environment Agency** ("the Agency") hereby confirm that the above named person is a/the registered holder of consent 3188

Nature of Discharge(s); Site Drainage  
at Finnleys Lane, West Cowick, Goole

Note: This certificate should be kept with the consent document for future reference. If you transfer responsibility for the discharge to somebody else you must pass the consent to them and tell the Agency within 21 days. **Responsibility for the consent cannot be disclaimed by the holder but the registration of holder may be transferred to a successor.** To do this please complete the form below, then tear it off and return it to the address shown. If you fail to transfer the consent, even though you are no longer on the site, you may still be liable for prosecution for pollution. If you transfer the consent but do not tell us, you will be committing an offence. In case of any queries please contact your local Environment Agency office.

**Part B** Please complete in block capitals or type.

To: ENVIRONMENT AGENCY

**Water Resources Act 1991: Notice of transfer of consent to discharge**

Consent: 3188 Name: The Project Manager  
Address: Highways Agency  
P. O. Box 206  
City House  
New Station Street  
Leeds  
LS1 4UR

I/We\* hereby serve notice on the Agency that I/we\* am/are\* no longer a/the\* Holder of the above consent which will be/was\* transferred to: \* delete as appropriate

Name(s) of new holder(s):

Address:

Post Code:

Date of Transfer to new Holder(s); .....

Signed: .....

Dated: .....

Name (block capitals): .....

Position: .....





**HIGHWAYS**  
AGENCY

RECEIVED  
19 OCT 1995  
ADMIN O.H.

file #  
3188

Northern Network Management Division  
P O Box 206  
City House  
New Station Street  
LEEDS LS1 4UR

National Rivers Authority  
Olympia House  
Geldard Lane  
LEEDS  
LS12 6DD

Facsimile: 0113 283 5315  
Switchboard: 0113 283 6300

Direct Line: 0113 283 6505

Date: 16 October 1995

Our ref: YHNMD 11/10/14

Your ref: AV/3188

Dear Sir

**WATER RESOURCES ACT 1991  
CONSENT TO DISCHARGE AT FINNLEYS LANE, WEST COWICK  
CONSENT No 3188**

I acknowledge receipt of your letter of 10 October 1995 together with the consent.

The name to which future correspondence should be addressed is Mr J Bagley at the above address.

Yours faithfully

D MAHER  
Maintenance East

sl

Consent No:3188 Review No.1

WATER RESOURCES ACT 1991

SECTION 88 - SCHEDULE 10

REVIEW NO.1 OF CONSENT TO DISCHARGE

To: HIGHWAYS AGENCY  
City House  
New Station Street  
Leeds  
LS1 2QG

COPY

The NATIONAL RIVERS AUTHORITY in pursuance of its powers under the Water Resources Act 1991 HEREBY CONSENTS to the making of a discharge, as follows:  
  
Site Drainage

From: HIGHWAYS DEPOT

At: Finnleys Lane  
West Cowick

To: Carr Drain

SUBJECT TO the conditions set out in the following schedules:  
  
Site Drainage - Schedule 1

Subject to the provisions of Paragraphs 6 and 7 of Schedule 10 of the Water Resources Act 1991, no notice shall be served by the Authority, altering this consent without the agreement in writing of the discharger, during a period of 2 years from the date this consent takes effect or such later date as may be specified in an endorsement to this document.

This consent is issued and takes effect on the 10... day of October 1995

Signed: *Gerald Morris*

G M Morris, Water Resources and Quality Manager


**CONDITIONS OF CONSENT TO DISCHARGE**

**Nature of effluent:** Site Drainage  
**From:** Highways Depot, Finnleys Lane, West Cowick  
**To:** Carr Drain  
**NGR:** SE 647 206

**CONDITIONS 1 - 6**

1. (a) The discharge shall not contain any poisonous, noxious or polluting matter or solid waste matter.  
  
(b) Provided that the discharge hereby consented is made in accordance with the following conditions of this consent, such discharge shall not be taken to be in breach of condition (a) above by reason of containing substances or having properties identified in and controlled by those conditions.
2. The discharge shall be made from an outlet at National Grid Reference SE 647 206 into the Carr Drain.
3. The discharge shall consist solely of site drainage from the Highways depot at Finnleys Lane.
4. The outlet to the watercourse shall be constructed, maintained and appropriately labelled so that a representative sample of the effluent discharged may be obtained.
5. No sample of the discharge shall contain more than:
  - (i) 30 milligrams per litre of suspended solids (measured after drying at 105 degrees Celsius).
  - (ii) 5 milligrams per litre of non-volatile matter extractable by petroleum ether.

6. As far as is reasonably practicable, the site shall be operated so as to prevent:
- (a) any matter being present in the effluent, other than matter specifically covered by numerical conditions in this consent, to such an extent as to cause the receiving waters, or any waters of which the receiving waters are a tributary, to be poisonous or injurious to fish in those waters, or to the spawning grounds, spawn or food of fish in those waters, or otherwise cause damage to the ecology of those waters; and
  - (b) the treated effluent from having any other adverse environmental impact.

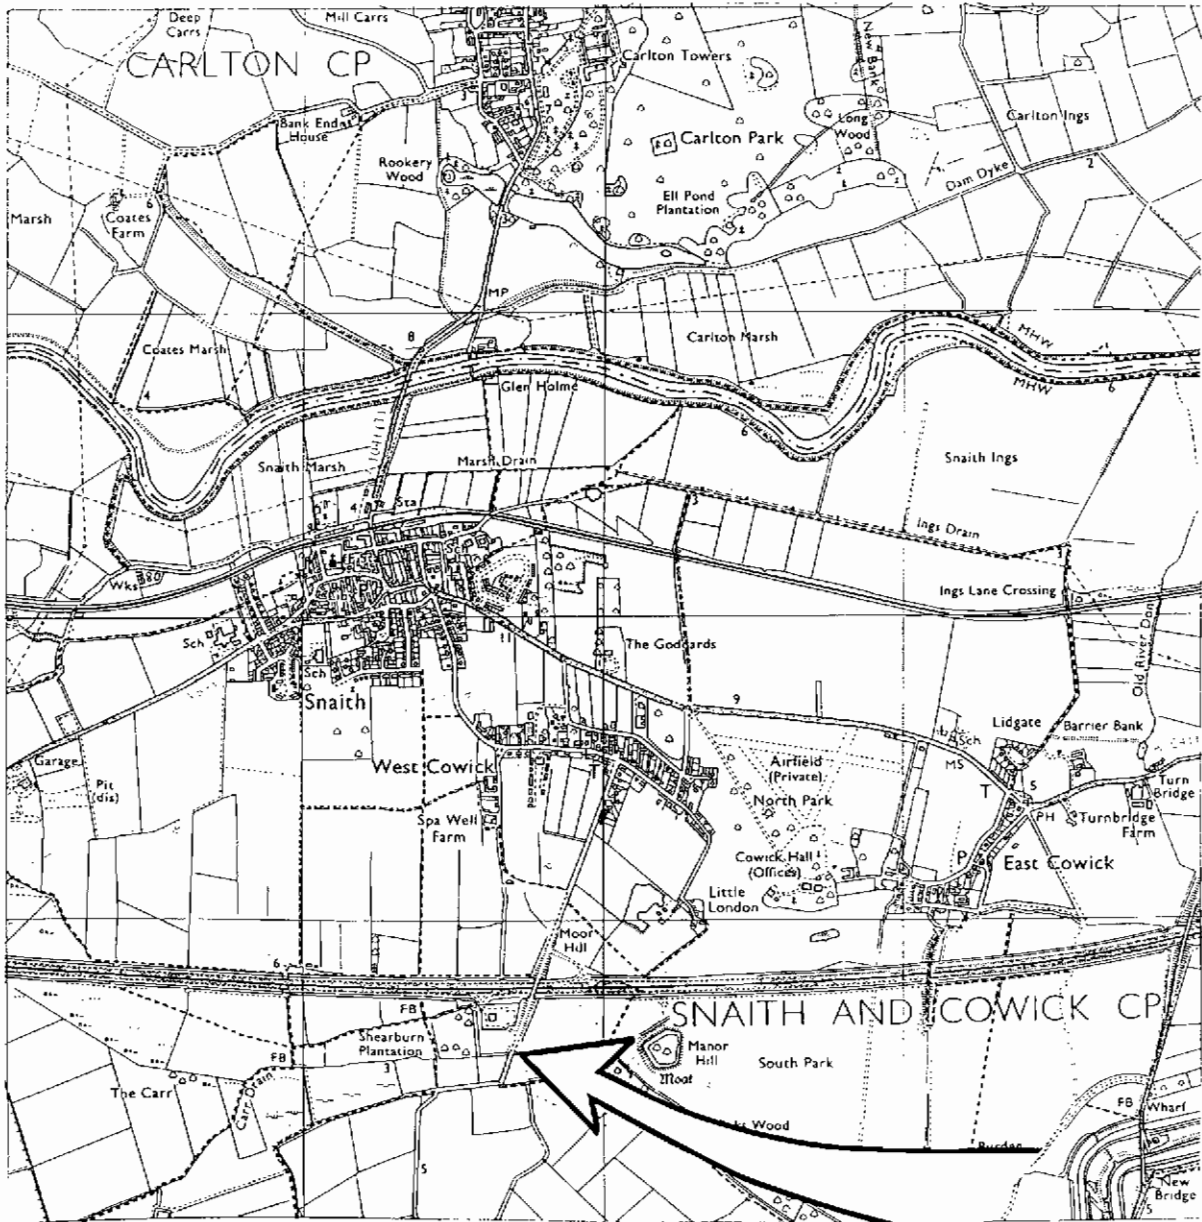

**LOCATION OF:**

**HIGHWAYS DEPOT**  
**WEST COWICK**

BASED UPON THE ORDNANCE SURVEY MAP  
WITH SANCTION OF THE CONTROLLER  
OF H.M.S.O. CROWN COPYRIGHT RESERVED  
LICENCE NO.WU29859X

**M E M O R A N D U M**

**To:** Gordon Poyser, Consents Admin

**From:** Steve Sargeant, CFD Admin

**Our ref:** SS/

**Your ref:**

**Date:** 27th February 1994



**NRA**

*National Rivers Authority  
Northumbria & Yorkshire Region*

*for review  
enter up.*

Gordon,

**CONSENT 3051 - VEHICLE WASH WATER, HIGHWAYS DEPOT, WEST COWICK**

Please can you pass this to the relevant EPO for consideration. I'm not sure what Mrs Charlesworth expects to gain from a review as the discharge is clearly vehicle wash water, however there is BOD on the consent which puts it in band C content.

Given the Highways Agency's comments on the discharge I would appreciate an EPO confirming that the consent is correct and appropriate for the site.

Thanks,

**STEVE SARGEANT - CFD ADMIN**



*CFD*



NATIONAL RIVERS AUTHORITY  
SOUTHERN YORKSHIRE REGION  
INTERNAL MEMORANDUM



National Rivers Authority  
Northumbria & Yorkshire Region

From: Authorisations Section

To: Joanne Haigh

Consent No.: 3051

Date: 3 March 1995

**REVIEW OF CONSENTS**

As a result of the consents validation procedure, we have been asked by the discharger to review the above consent as the attached paperwork.

Could we please have your comments on your agreement or otherwise as soon as possible.

**PLEASE RETURN ALL THE ATTACHED PAPERWORK**

**Water Resources and Quality Section**

(Review 351)

From: Joanne Haigh

To: Authorisations Section  
Olympia House

**REVIEW OF CONSENT**

~~I agree to the review of consent No. 3051 (CONDITIONS ATTACHED)~~

\* I do not agree to the review of consent No.3051 for the following reasons  
*The B.O.D. Condition is to prevent the use of  
Detergents / de greasing agents.*

Signed: *JM Haigh*

Date: *24<sup>th</sup> August 1995*

Catchment: *Lower Aire*

\* Please delete as appropriate

(Review 351)



**MEMORANDUM**

**To :** Karen Wooster

**From :** Joe Haigh  
**Ext No :** 2157

**Our Ref :** 3051/ 3188  
**Your Ref :**

**Date :** 24 August 1995

---

**Subject:** Consents to Discharge at East Cowick Highways Depot

I have got two consent reviews for the Highways Depot at East Cowick regarding the Biochemical Oxygen Demand conditions on the consents for the site.

The Humberside County Council consent **3188** is for site drainage only. It should not have a BOD on the consent and this can be reviewed as such.

The Department of the Environment consent **3051** is for vehicle washwater and as such needs to be regulated to prevent the use of detergents and degreaseants and therefore the BOD should stay on the consent.

Thanks



**Joe Haigh**  
Environmental Protection Officer

Review  
3188



**NRA**

*National Rivers Authority  
Northumbria & Yorkshire Region*



Awarded for excellence

our ref: AV/3188

your ref:

Date: 10 October 1995

Highways Agency  
City House  
New Station Street  
Leeds  
LS1 2QG



*National Rivers Authority  
Northumbria & Yorkshire Region*

COPY

Dear Sir

**WATER RESOURCES ACT 1991  
CONSENT TO DISCHARGE AT-FINNLEYS LANE WEST COWICK  
CONSENT NO.3188**

Please find enclosed the Review of Consent Number 3188.

If you consider that the conditions imposed by the consent are unreasonable you have a right of appeal to The Planning Inspectorate, Room 10/13 Tollgate House, Houlton Street, Bristol, BS1 9DJ.

Notice of an appeal must be given in writing within three months of this notification and must be accompanied by a statement of the grounds of appeal.

The grant of the consent does not alter the need to obtain any other consents or approvals which might be required in connection with your proposals under other legislation.

I shall be pleased if you will acknowledge receipt of this letter and the consent.

Please notify the Authority of the name and address of any person who becomes responsible in your place for this discharge in the future.

Yours faithfully

Angela Vinand  
Authorisations Section



Awarded for excellence



IS B.O.D. REQUIRED ON THIS SITE DRAINAGE CONSENT?  
- CAUSES CONSENT TO FALL INTO TRADE CATEGORY.

YORKSHIRE WATER AUTHORITY Steve Sargan

- PLEASE REMOVE IF NOT NECESSARY.

26/7/98

A. B. Baldwin  
Chief Executive

REMOVE

West Riding House  
67 Albion Street  
Leeds LS1 5AA

Your ref: 2/5/JEA/VG  
Our ref: DRP/LIC. Consent No. 3188.

Telephone: 448201  
(STD 0532)

RECORDED DELIVERY  
23rd December, 1976.

Mr. L. F. Crossley,  
Director of Technical Services,  
Humberside County Council,  
Technical Services Department,  
Eastgate,  
Beverley,  
North Humberside, HU17 ODE.

COPY

Dear Sir,

Rivers (Prevention of Pollution) Act 1951 - section 7  
Highways Depot, Finnley's Lane, West Cowick  
Boothferry District  
Trade Effluent

Referring to your application dated 18th October 1976 for consent to a new outlet and new discharge of site drainage therefrom to Carr Drain at the proposed new Highways Depot, Finnley's Lane, West Cowick,


CONSENT IS HEREBY GRANTED by the Authority to the Humberside County Council under section 7 of the Rivers (Prevention of Pollution) Act 1951 to the new (150 millimetre) outlet to Carr Drain at the relevant point '(2)' indicated in the submitted Drawing No. 1A dated 18th June 1975, subject to the outlet being constructed so as to enable samples of the effluent to be conveniently obtained and otherwise to the approval of the Director of the Authority's Rivers Division.

CONSENT IS ALSO GRANTED under section 7 of the Rivers (Prevention of Pollution) Act 1951 to the new discharge of trade effluent, namely site drainage, from the above-mentioned outlet subject to the following conditions as to the nature and composition of the effluent:-

- (1) The solids in suspension dried at 105 degrees Celsius shall not exceed 30 milligrammes per litre;
- (2) The Biochemical Oxygen Demand in five days at 20 degrees Celsius shall not exceed 20 milligrammes per litre; and
- (3) Non-volatile matter extractable by petroleum ether shall not exceed 5 milligrammes per litre.

The terms of this consent will not, without the consent in writing of the person to whom this consent is given (or his successor), be altered before the expiration of the period ending with the thirty-first day of December 1978.

Yours faithfully,

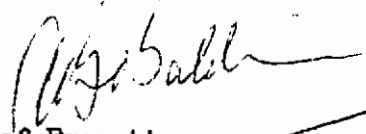

Chief Executive.

# YORKSHIRE WATER AUTHORITY

Your ref: 2/5/JEA/VG  
Our ref: DRP/LIC. Consent  
Nos. 3188 and 3189.

Directorate of Resource Planning  
21 Park Square South  
Leeds LS1 2QG

Telephone: 459404  
(STD 0532)

23rd December, 1976.

Mr. L. F. Crossley,  
Director of Technical Services,  
Humberside County Council,  
Technical Services Department,  
Eastgate,  
Beverley,  
North Humberside, HU17 ODE.

COPY


Dear Sir,

Rivers (Prevention of Pollution) Act 1951 - section 7.  
Highways Depot, Finnley's Lane, West Cowick  
Boothferry District  
Trade and Sewage Effluents.

With reference to the Consents (numbered 3188 and 3189) enclosed with this letter, there is no objection to the proposed outlets from the land drainage aspect provided that:-

- (1) Details of the outfalls are submitted for the approval of the Cowick Internal Drainage Board, since Carr Drain is a main drain of that Board. (It has been noted that work has commenced on the construction of Outlet No. 3); and
- (2) Non return flaps are provided at the outlet points to prevent surface water entering the foul and trade systems.

Yours faithfully,



Directorate of Resource Planning.

YORKSHIRE WATER AUTHORITY

DISCHARGE OF SEWAGE OR TRADE EFFLUENT TO STREAM

Rivers (Prevention of Pollution) Act, 1951 - Section 7\*

APPLICATION by ..... Rusherside County Council - Technical Services Department,.....

Address ..... Eastgate,.....

..... BEVERLEY..... Tel. No. Beverley 886291.....

On behalf of ..... As above.....

Address ..... } if applicable

for CONSENT to bring into use a NEW or ALTERED OUTLET for the discharge of SEWAGE or TRADE EFFLUENT to a stream, and/or to begin to make a NEW DISCHARGE of SEWAGE or TRADE EFFLUENT to a stream.

1. (a) Full address or other sufficient description of land or premises to which application relates:-  
..... Divisional Highways Dept......  
..... Fimleys Lane.....  
..... West Covet.....
- (b) Local government district:- ..... Southferry District Council.....
- (c) Name of stream:- ..... Carr Drain.....

2. Particulars relating to a proposed NEW or ALTERED OUTLET:-

- (a) Precise location - this should be shown on an accompanying site plan.  
National Grid Reference:- .. 647206.....
- (b) Details of construction - size and brief description of outlet and any supporting structure in stream bank. In the case of a substantial construction in a stream bank a detailed drawing should accompany this application.  
Two 150 mm diameter surface water outlets.....  
(positions 1 and 2 on drawing number E.150/1) and.....  
1 no. 100 mm diameter outlet from Septic Tank (position 3).....  
The outlets to be set in concrete......
- (c) The proposed use of the outlets:- ..... 2 No. outlets for surface water,  
and 1 No. outlet from Septic Tank.....
- (d) Is the outlet to be so constructed as to enable samples of the effluent to be obtained? ..... The outlets will be  
open ended.....

\* Under this Act a "stream" includes any river or other watercourse, whether natural or artificial.

# YORKSHIRE WATER AUTHORITY

A. B. Baldwin  
Chief Executive

West Riding House  
67 Albion Street  
Leeds LS1 5AA

Your ref: 2/5/JEA/VG  
Our ref: DRP/LIC. Consent No. 3188.

Telephone: 448201  
(STD 0532)

RECORDED DELIVERY

23rd December, 1976.

Mr. L. F. Crossley,  
Director of Technical Services,  
Humberside County Council,  
Technical Services Department,  
Eastgate,  
Beverley,  
North Humberside, HU17 ODE.

COPY

Dear Sir,

Rivers (Prevention of Pollution) Act 1951 - section 7  
Highways Depot, Finnley's Lane, West Cowick  
Boothferry District  
Trade Effluent

Referring to your application dated 18th October 1976 for consent to a new outlet and new discharge of site drainage therefrom to Carr Drain at the proposed new Highways Depot, Finnley's Lane, West Cowick,

CONSENT IS HEREBY GRANTED by the Authority to the Humberside County Council under section 7 of the Rivers (Prevention of Pollution) Act 1951 to the new (150 millimetre) outlet to Carr Drain at the relevant point '(2)' indicated in the submitted Drawing No. 1A dated 18th June 1975, subject to the outlet being constructed so as to enable samples of the effluent to be conveniently obtained and otherwise to the approval of the Director of the Authority's Rivers Division.

CONSENT IS ALSO GRANTED under section 7 of the Rivers (Prevention of Pollution) Act 1951 to the new discharge of trade effluent, namely site drainage, from the above-mentioned outlet subject to the following conditions as to the nature and composition of the effluent:-

- (1) The solids in suspension dried at 105 degrees Celsius shall not exceed 30 milligrammes per litre;
- (2) The Biochemical Oxygen Demand in five days at 20 degrees Celsius shall not exceed 20 milligrammes per litre; and
- (3) Non-volatile matter extractable by petroleum ether shall not exceed 5 milligrammes per litre.

The terms of this consent will not, without the consent in writing of the person to whom this consent is given (or his successor), be altered before the expiration of the period ending with the thirty-first day of December 1978.

Yours faithfully,



Chief Executive.

67 at Leeds 459404

# YORKSHIRE WATER AUTHORITY

Your ref: 2/5/JEA/VG  
Our ref: DRP/LIC. Consent  
Nos. 3188 and 3189.

Directorate of Resource Planning  
21 Park Square South  
Leeds LS1 2QG

Telephone: 459404  
(STD 0532)

23rd December, 1976.

Mr. L. F. Crossley,  
Director of Technical Services,  
Humberside County Council,  
Technical Services Department,  
Eastgate,  
Beverley,  
North Humberside, HU17 0DE.

Dear Sir,

Rivers (Prevention of Pollution) Act 1951 - section 7.  
Highways Depot, Finnley's Lane, West Cowick  
Boothferry District  
Trade and Sewage Effluents.

With reference to the Consents (numbered 3188 and 3189) enclosed with this letter, there is no objection to the proposed outlets from the land drainage aspect provided that:-

- (1) Details of the outfalls are submitted for the approval of the Cowick Internal Drainage Board, since Carr Drain is a main drain of that Board. (It has been noted that work has commenced on the construction of Outlet No. 3); and
- (2) Non return flaps are provided at the outlet points to prevent surface water entering the foul and trade systems.

Yours faithfully,



Directorate of Resource Planning.