

NATIONAL RIVERS AUTHORITY
WESSEX REGION

WATER RESOURCES ACT 1991
SECTION 88 AND SCHEDULE 10

NOTICE OF CONSENT TO DISCHARGE
Consent Number 011978

The terms of this consent will not, without the consent in writing of the person (named below) to whom this consent is given (or his successor), be altered before the expiration of the period ending two years after the date on which the consent takes effect.

If you are not satisfied with the terms of this consent you may appeal to the Secretary of State for the Environment; any such appeal has to be made within three months of the issue of the consent.

SIGNED FOR AND ON BEHALF OF THE AUTHORITY

DATE

14/12/92

Catchment Planning Manager

Name and Location of Site

Westbury Landfill Site
Trowbridge Road
Westbury, Wiltshire

Name and address of person
to whom this consent is given

Blue Circle Waste Management
Landfill Division, Blue Circle House
Holborough, Snodland, Kent, ME6 5PH

The conditions specified in this consent shall apply on and after the date of issue of this consent.

National Rivers Authority
Wessex Region
Rivers House
East Quay
BRIDGWATER
Somerset
TA6 4YS

Name of Site: Westbury Landfill Site
Trowbridge Road
Westbury, Wiltshire

Name of person or body responsible for the operation of the site: Blue Circle Waste Management

Name of receiving stream: the Heywood Brook
in the River Biss Catchment

National Grid Reference of the site main entrance: ST 8871 5310

The outlet and sampling point at this site to which the consent relates are listed below and are marked on the attached map/plan using the same reference code or number.

Outlet		Sampling Point	
Code	NGR	Number	NGR
A	ST 8874 5307		At the Outlet A

CONSENT CONDITIONS

- 1 / Outlet A shall be used only for the discharge of site drainage derived from the premises indicated on the attached plan. (shaded area). The site drainage shall be subject to settlement in lagoons and treatment in a clarifier system prior to discharge at Outlet A.
- 2 / Samples of the discharge will be obtained at the Outlet A
- 3 * The maximum rate of flow of site drainage discharged via outlet A shall not exceed 10 l/sec. The maximum daily volume of site drainage discharged via outlet A shall not exceed 864 m³/day.
- 4 The discharge of site drainage shall not:-
 - (a) * have a biochemical oxygen demand (nitrification suppressed) over 5 days at 20 °C in excess of 10 mg/l.
 - (b) / contain suspended solids (dried at 105 °) in excess of 10 mg/l.
 - (c) / have an ammoniacal nitrogen concentration (as N) in excess of 5 mg/l.
 - (d) / have a pH less than 6 nor greater than 9.
 - (e) / contain iron in excess of 3 mg/l.
- 5 / The sampling point shall be maintained in a satisfactory and safe condition and shall be accessible at all times to the Authority's representatives for the purpose of taking samples.
- 6 / The discharge shall not contain oils or grease in sufficient quantity to produce a visible film on the surface of the receiving water.

CONSENT CONDITIONS CONTINUED

- 7 The discharger shall install and maintain suitable flow measuring structures to measure the volume and rate of flow of the discharge. At the written request of the Authority the discharger shall measure and record the volume and rate of flow at these points. The discharger shall make returns of the information to the Authority at the frequency and in the form and manner requested. The discharger shall also make available to the Authority any other flow records which are held. Flow measuring devices shall be accessible at all times without delay to the Authority's representatives. Facilities will be provided to enable the Authority to install flow measuring equipment as required.
- 8 The discharge shall not contain any substances or combination of substances at a concentration to cause in the receiving water toxic, injurious or avoidance effects to fauna or flora.


This consent includes a copy of an ordnance survey map showing the location of the land or premises and the outlet to which this consent relates, the receiving stream and other immediate surroundings.

This consent includes a copy of an outline plan showing the location of the outlet and the sampling point relative to the receiving stream, the entrance to the land and premises and the principal adjacent structures. The outlet and sampling point marked on the plan have the same designation as those used in the consent.

Any conditions imposed by this consent unless annulled or varied by the Secretary of State upon appeal under Section 91 of the Water Resources Act 1991 shall continue in force unless and until varied or revoked by the National Rivers Authority or by the Secretary of State under Section 91 of the said act; and any such conditions are binding on any person discharging effluent from the land or premises to which the conditions relate.

Failure to comply with the terms of this consent is an offence under Section 85 of the Water Resources Act 1991.

NATIONAL RIVERS AUTHORITY
WESSEX REGION
Consent Number: 011978

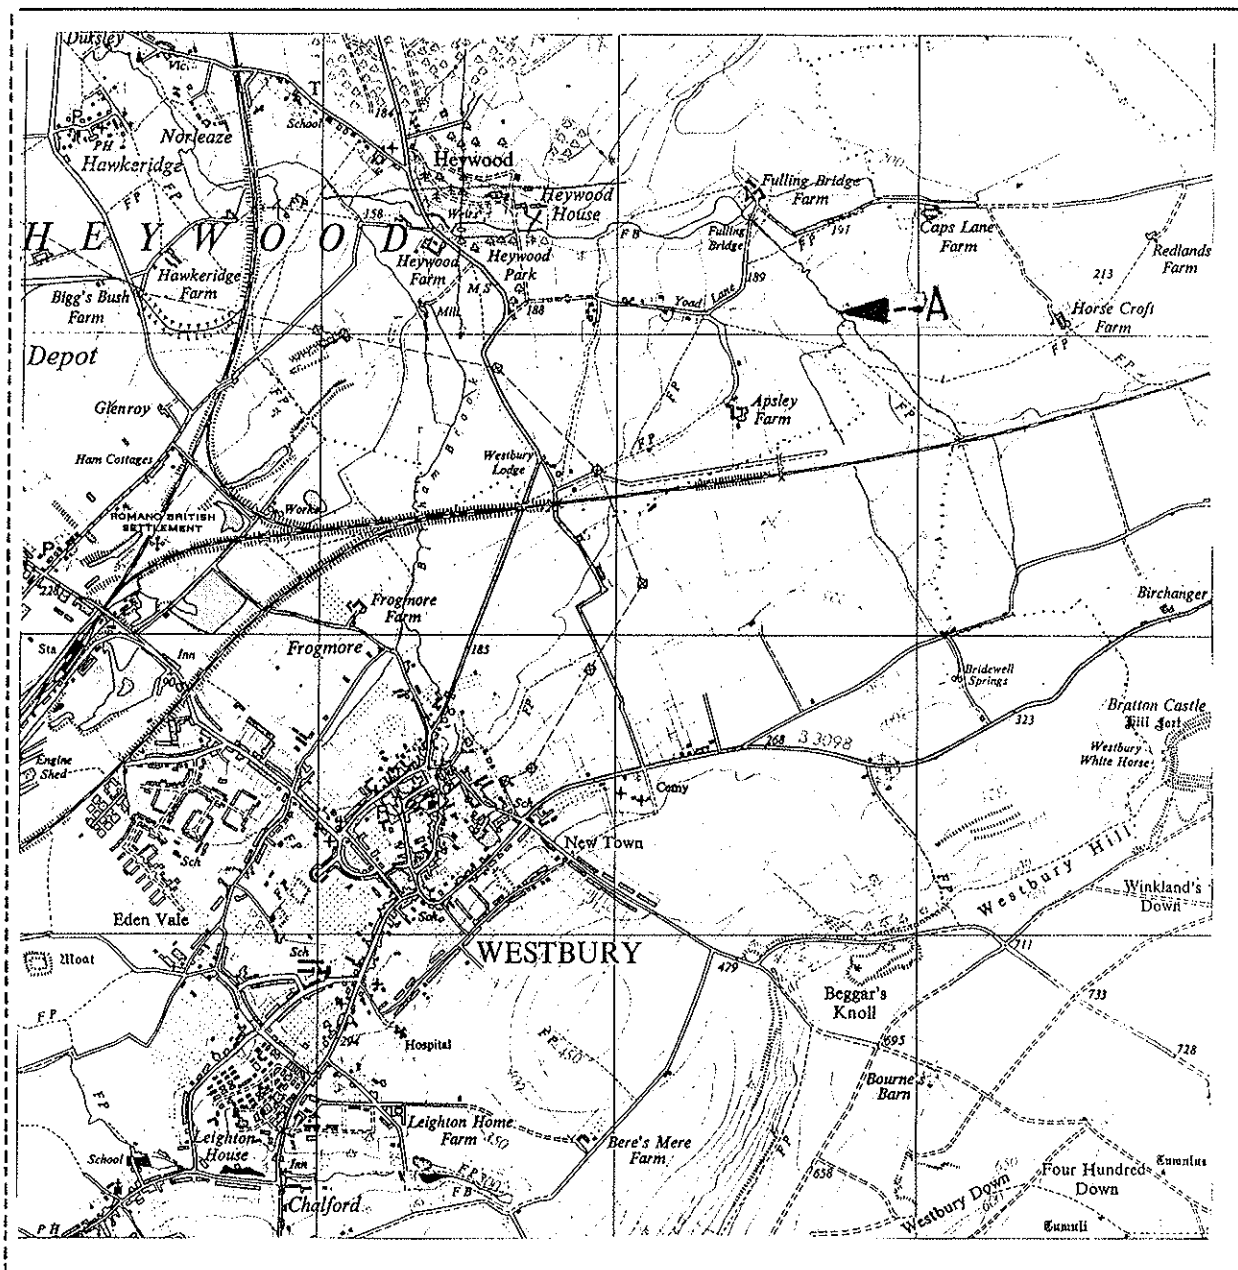

Date: NOVEMBER 1992

Outlet:
A / ST 8874 5307


Sample Point:
1 / At the Outlet A

WESTBURY LANDFILL SITE

TROWBRIDGE ROAD

WESTBURY, WILTSHIRE

NATIONAL RIVERS AUTHORITY
WESSEX REGION
Consent Number: 011978

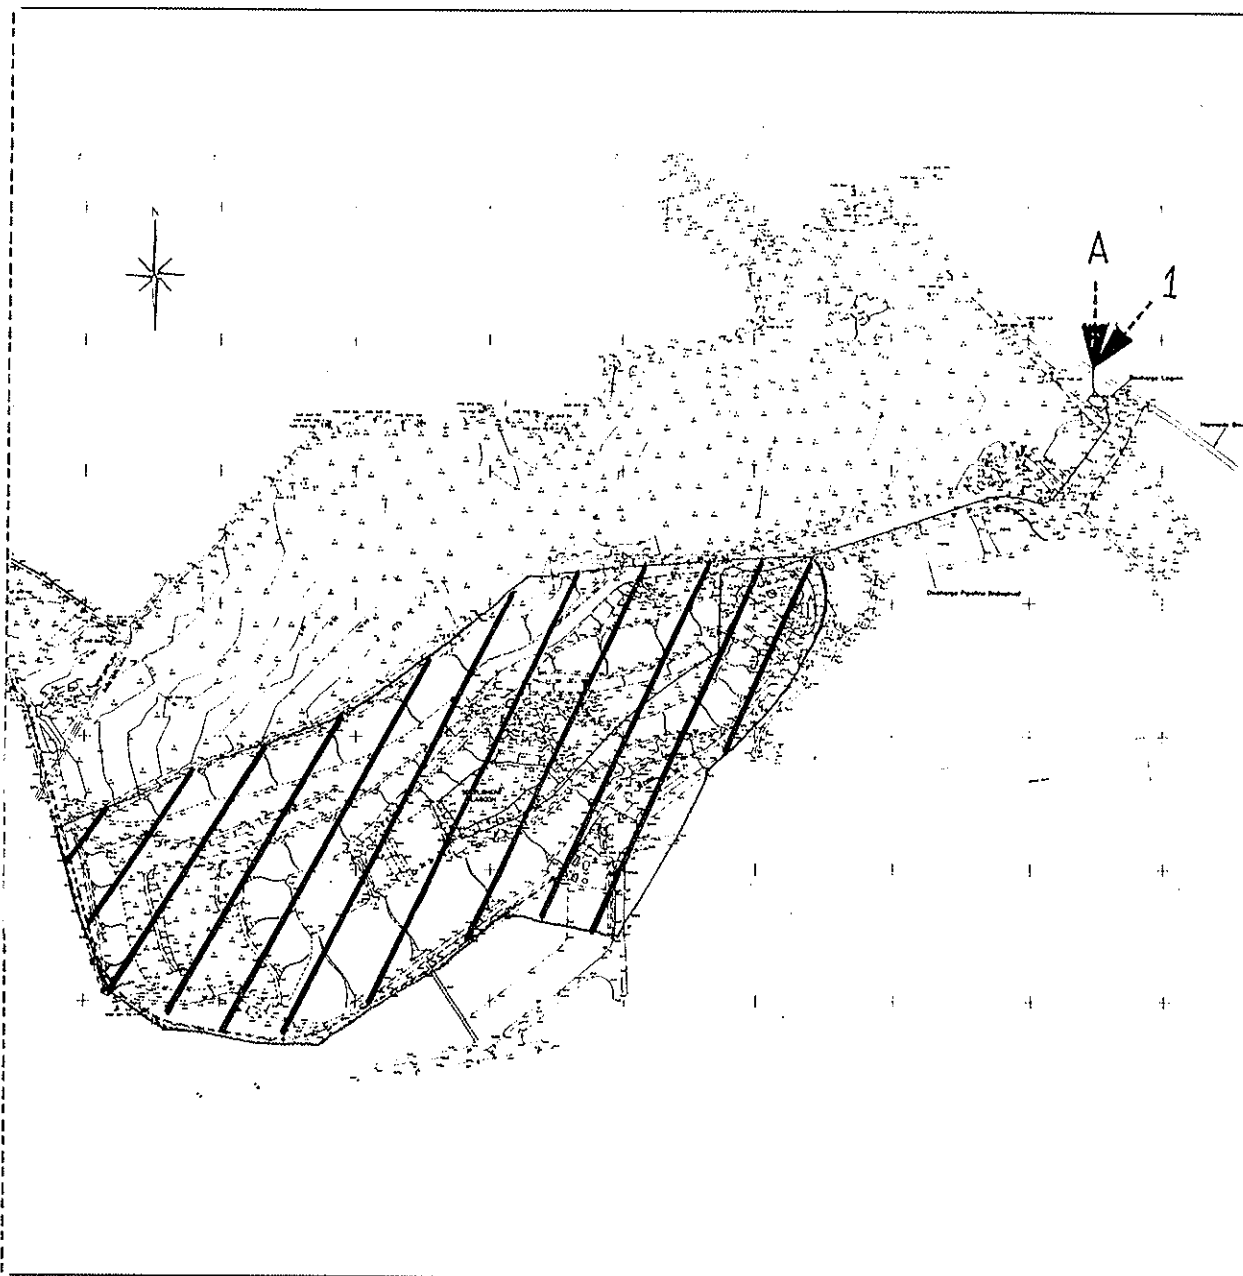

Date: NOVEMBER 1992

Outlet:
A / ST 8874 5307

Sample Point:
1 / At the Outlet A

WESTBURY LANDFILL SITE

TROWBRIDGE ROAD

WESTBURY, WILTSHIRE

A handwritten signature in black ink, consisting of a stylized 'J' followed by a horizontal line.