

CTWC.2462,

THAMES WATER AUTHORITY

RP 74/2265

CONTROL OF POLLUTION ACT 1974
PART II POLLUTION OF WATERCONSENT

to discharge sewage or trade effluent or other matter

TO: Natta Construction Limited
Moorlands
87 Aldershot Road
Fleet
Hampshire GU13 9NW

The THAMES WATER AUTHORITY ("the Authority") pursuant to Section 34 of the Control of Pollution Act 1974 HEREBY CONSENT to the making of the discharge described in the First Schedule overleaf in accordance with your application dated 26 August 1987, the letter dated 13 January 1988 and the plan attached hereto SUBJECT to the conditions set out in the Second Schedule overleaf.

The terms of this consent will not, without the agreement in writing of the person to whom this consent is given (or his successor) be altered before the expiration of the period ending with the 31 day of May 1990 except in accordance with the provisions of Section 38(3) of the Control of Pollution Act 1974.

Dated this 24 day of May 1988

Nugent House
Vastern Road
Reading
Berks RG1 8DB

David Bodunk
.....
SECRETARY

NOTES

1. This Consent does not exempt the applicant from obtaining any consent required by, or from complying with, any other statutory provisions, statutory instruments or byelaws.
2. There must be no departure from the approved application and plan without the prior written permission of the Authority.
3. Any question as to the reasonableness of the conditions of this Consent shall be determined by the Secretary of State for the Environment. Any reference to the Secretary of State must be made within 3 months from the date on which the applicant was notified by the Authority of their decision, or within such longer period as the Secretary of State may at any time allow.
4. This Consent shall continue in force (subject to any variation) until revoked, and shall be binding on any person discharging effluent in accordance with the Consent.
5. The Authority may at any time, by notice in writing to the person making the discharge in pursuance of this Consent, revoke the Consent if it is reasonable to do so or make reasonable modifications of its conditions.
6. Section 38(3) provides that if the Authority serves such a notice on the discharger within the period specified above and without the latter's written agreement, then circumstances may arise in which the Authority will become liable to pay compensation (Section 38(4)).

FIRST SCHEDULE

Description of Discharge

The making of a discharge of sewage effluent from premises at Rose Yard, Mill Lane, Crondall, Hampshire to the Itchell Brook.

SECOND SCHEDULE

Conditions


1. The discharge shall be made at National Grid Reference SU 784 503 at the point indicated on the plan attached hereto.
2. The discharge shall be made by means of one or more pipe outlets.
3. The discharge shall consist only of sewage effluent.
4. The discharge shall conform to the following standard:
 - (a) Suspended solids dried at 105°C not to exceed 45 milligrammes per litre.
 - (b) Biochemical oxygen demand in 5 days at 20°C (nitrification suppressed with allylthiourea) not to exceed 30 milligrammes per litre.
5. The discharge shall not contain any trace of oil or grease.
6. The discharge shall not contain any matter which will cause or be likely to cause the water in the Itchell Brook to be poisonous or injurious to fish or the spawning grounds, spawn or food of fish.
7. The volume of the discharge shall not exceed 6 cubic metres per day.
8. Facilities to enable the Authority's Officers to take samples of the discharge shall be provided and maintained at the outlet.

THAMES WATER AUTHORITY

CONTROL OF POLLUTION ACT 1974

Plan attached to Consent No CP2462

David Bodurke
Secretary

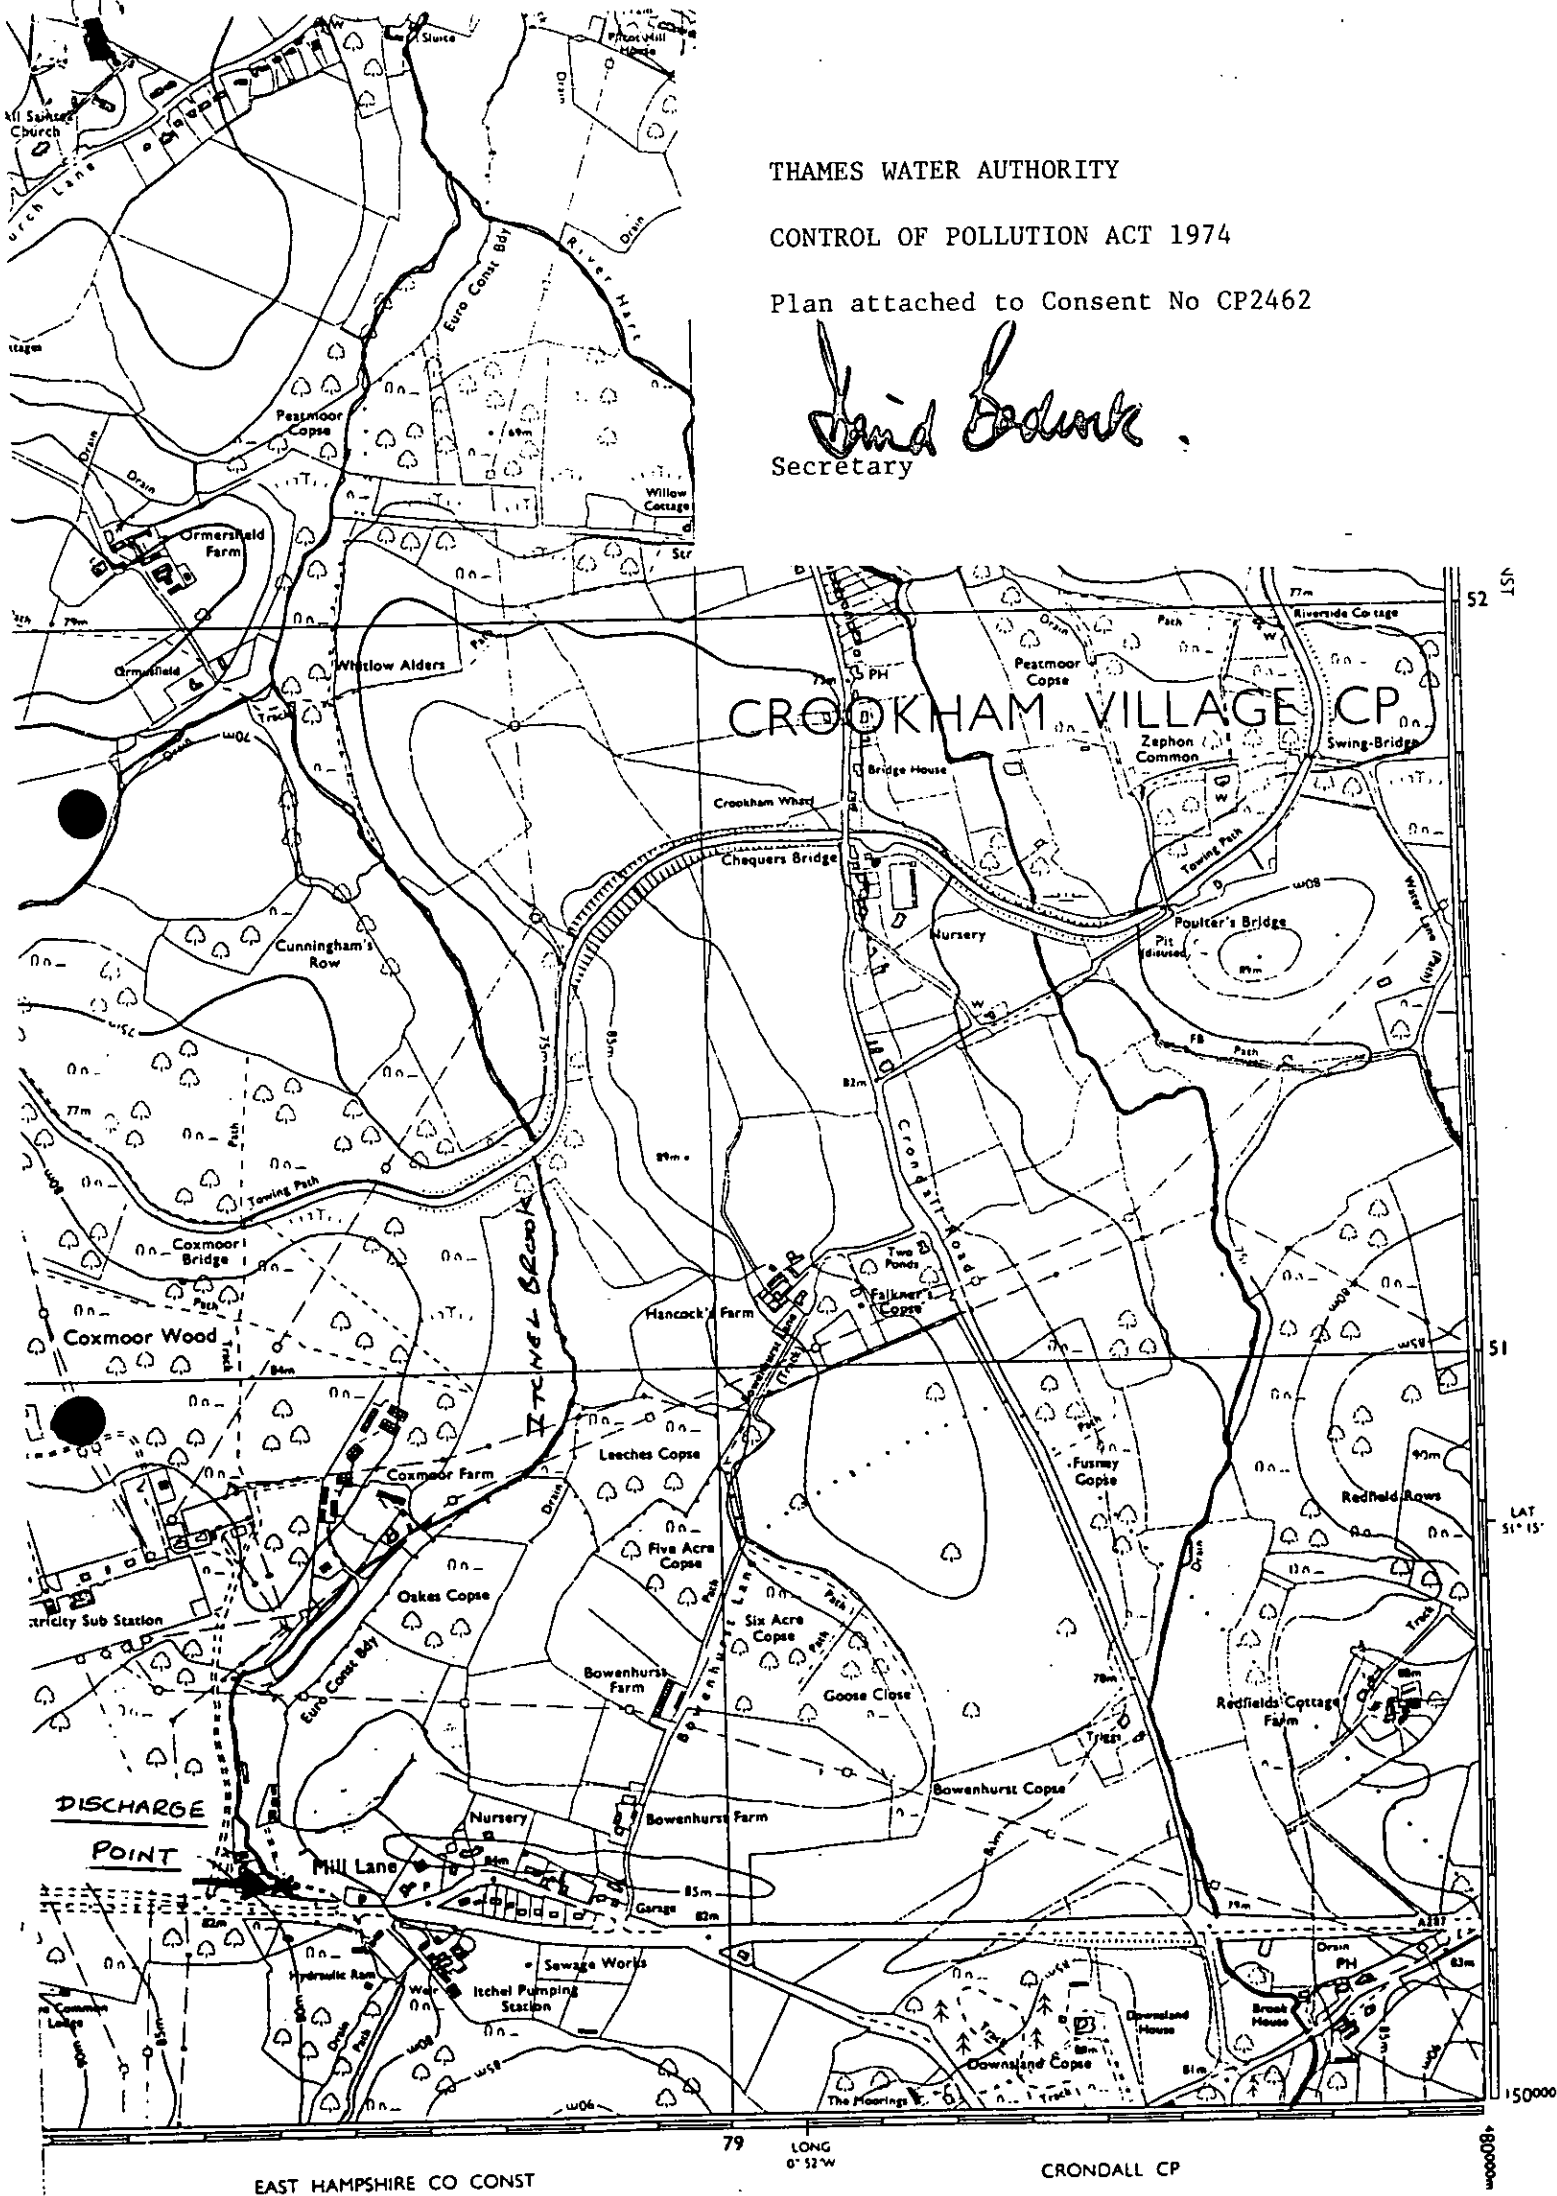

01 FEB 1995

**NATIONAL RIVERS AUTHORITY
THAMES REGION**

WATER RESOURCES ACT 1991

NOTICE IS HEREBY GIVEN in accordance with the tenth schedule to the Water Resources Act 1991 that **Consent CP2462** granted to Natta Construction Ltd by the Thames Water Authority on the 24th May 1988 for a discharge from premises at Rose Yard, Mill Lane, Crondall, Hampshire is hereby modified with the agreement of the discharger as follows:


In Condition 7, delete:

"The volume of the discharge shall not exceed 6 cubic metres per day."

and substitute therefor :

"The volume of the discharge shall not exceed 1 cubic metre per day."

The terms of this notice will not, without the agreement in writing of the person to whom this notice is given (or his successor) be altered before the expiration of the period of 24 months from the date of this notice.



Regional Scientific Manager

Date:

